

- Eastowne Transformer 345/161 kV
- Moundridge Transformer 138/115 kV
- Tuco – Amoco – Hobbs 345 kV with 345/230 kV transformers at Amoco and Hobbs

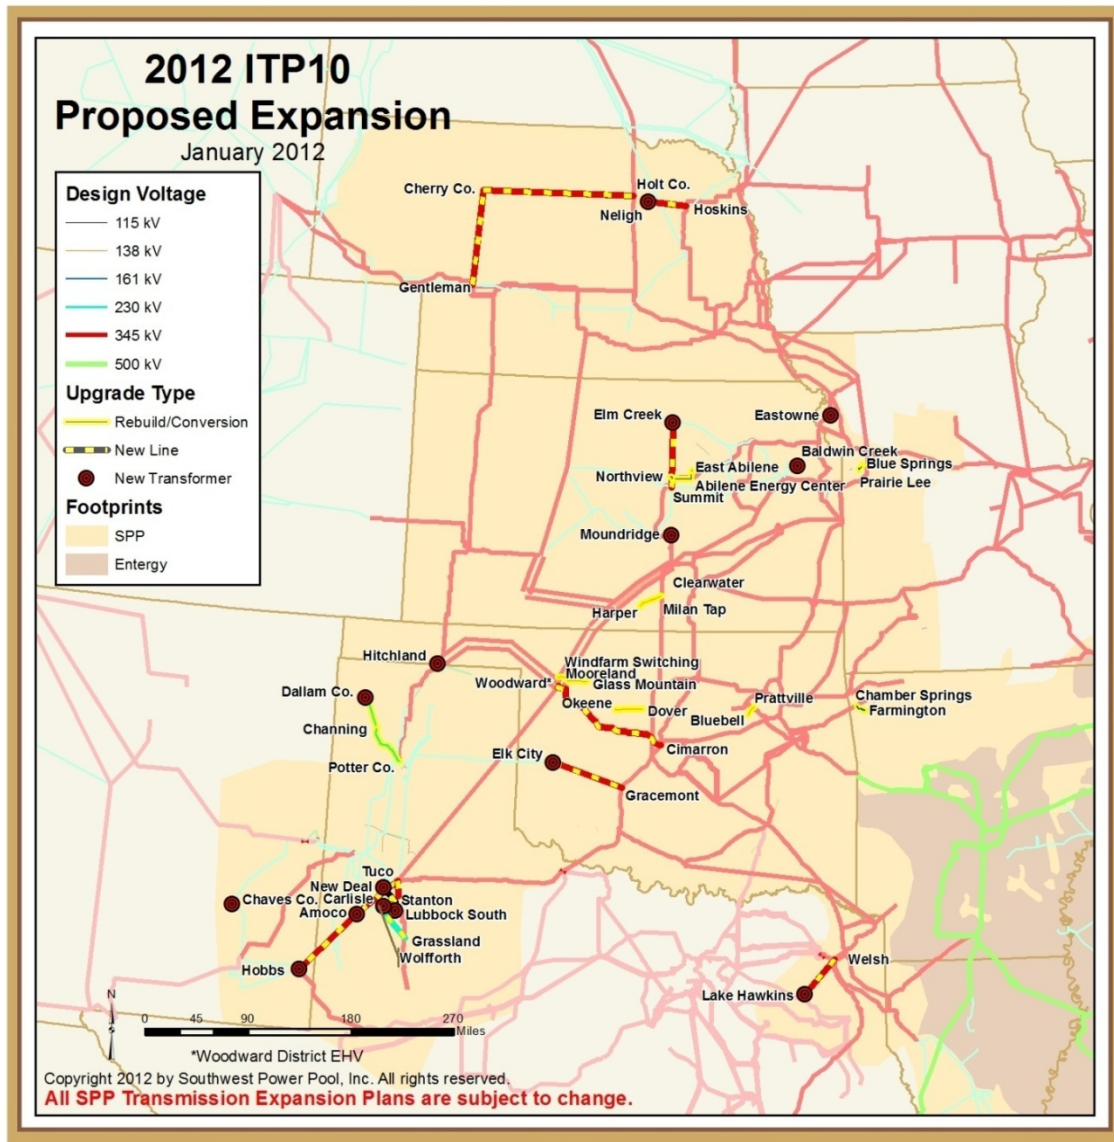


Figure 3:2012 ITP10 Proposed Expansion