



PJM Interconnection, L.L.C.
2750 Monroe Blvd
Audubon, PA 19403-2497

Jeanine S. Watson
Senior Counsel
T: (610) 666-4438 | F: (610) 666-8211
jeanine.watson@pjm.com

May 13, 2016

The Honorable Kimberly D. Bose, Secretary
Federal Energy Regulatory Commission
888 First Street, N.E., Room 1A
Washington, D.C. 20426-0001

*Re: PJM Interconnection, L.L.C. Docket No. ER16- _____-000
Wholesale Market Participation Agreement No. 4461; Queue No. W4-027*

Dear Secretary Bose:

Pursuant to section 205 of the Federal Power Act (“FPA”),¹ and part 35 of the regulations of the Federal Energy Regulatory Commission (“Commission” or “FERC”),² PJM Interconnection, L.L.C. (“PJM”) submits for filing an executed Wholesale Market Participation Agreement (“WMPA” or “Agreement”) entered into among PJM, Community Energy Renewables, LLC (“Wholesale Market Participant” or “CE”) and Atlantic City Electric Company (“Transmission Owner” or “ACE”), executed on January 5, 2015. PJM is submitting this Agreement for filing because the Wholesale Market Participant intends to engage in wholesale sales in the PJM markets from a generating facility connected to the Transmission Owner’s distribution facilities.

As described further in section V, below, PJM requests an effective date of January 5, 2015 for this WMPA, which is designated as Service Agreement No. 4461,³ and attached to this filing.

¹ 16 U.S.C. § 824d (2006).

² 18 C.F.R. Part 35 (2014).

³ Because this WMPA being electronically filed with this transmittal letter contains electronic signatures and not the original signatures of the parties, a copy of the sheet(s) containing the original signatures is included as Attachment A to this transmittal letter.

Honorable Kimberly D. Bose, Secretary
May 13, 2016
Page 2

The WMPA will facilitate the Wholesale Market Participant's intent to engage in jurisdictional wholesale transactions in the PJM markets, which will originate over the Transmission Owner's non-jurisdictional distribution facilities.

I. BACKGROUND

On February 22, 2006, the Commission issued the GSG Order,⁴ which held that the interconnection of a generator to non-jurisdictional distribution facilities is not, in and of itself, action regulated by the FPA.⁵ The Commission further stated that the distribution facilities become FERC jurisdictional once a wholesale transaction occurs on the system. This action would, therefore, render any subsequent interconnection to the relevant distribution facilities Commission jurisdictional.

PJM routinely receives requests from generation developers seeking to interconnect at a distribution level, in order to participate in sales to the PJM markets. Where the relevant facilities are non-jurisdictional (because there exists no previously interconnected generator engaging in wholesale transactions), and, in light of the GSG Order, PJM developed the WMPA as a contractual means to address these requests and provide to all affected parties a process to enable PJM to properly track and study this category of generator interconnection, as well as to facilitate the generator's participation in PJM's organized wholesale markets. The WMPA also serves to establish important revenue and (if necessary) operational metering requirements in order to give PJM visibility to pay the generator for output and for potential operational security requirements. In rare instances, a non-jurisdictional interconnection could impact the integrated transmission

⁴ See *PJM Interconnection, L.L.C.*, 114 FERC ¶ 61,191 (2006) ("GSG Order").

⁵ See *PJM Interconnection, L.L.C.*, 116 FERC ¶ 61,102 (2006) (Order Denying Rehearing and Clarification and noting the FPA denies the Commission jurisdiction "over facilities used in local distribution"). The Order denies the requests for rehearing filed on behalf of GSG, the American Wind Energy Association and Mendota Hills, LLC.

Honorable Kimberly D. Bose, Secretary
May 13, 2016
Page 3

system. The WMPA process allows PJM to ensure that this contingency is studied and corrected, if necessary.

At this time FERC has previously accepted a number of WMPAs in earlier filings involving other participants. The instant filing is in the same form as the earlier submittals.⁶

II. THIS WMPA ESTABLISHES REASONABLE REQUIREMENTS TO ENABLE WHOLESALE TRANSACTIONS SUBJECT TO THE COMMISSION'S JURISDICTION.

The instant WMPA is filed pursuant to the Commission's jurisdiction under section 205 of the FPA and the Commission's independent jurisdictional authority over wholesale sales of electric energy and related products in PJM's markets. These transactions plainly constitute regulated wholesale transactions pursuant to section 201(b)(1) of the FPA.⁷ Under the FPA, the Commission has broad jurisdiction to regulate the wholesale sale of electricity in interstate commerce.⁸ As noted above, the transactions will originate over facilities that are not Commission jurisdictional, namely the distribution facilities. In such circumstances, the Commission parses the transaction so as to apply its jurisdiction to only those aspects of the transaction that are Commission jurisdictional. For example, the Commission applies this logic to determine jurisdiction over an interconnection on a facility used for both retail and wholesale transactions as discussed in Order No. 2003,⁹ by segregating the jurisdictional transaction from

⁶ See *PJM Interconnection, L.L.C.*, Docket Nos. ER12-2594-000; ER12-2610-000; ER12-2550-000; ER12-2409-000; ER12-2294-000; ER12-2421-000; ER12-2416-000; ER12-2174-000; ER12-2293-000; ER12-2155-000; ER12-2126-000; ER12-2128-000 and ER12-2143-000.

⁷ Specifically, the FPA applies "to the transmission of electric energy in interstate commerce and to the sale of electric energy at wholesale in interstate commerce." 16 U.S.C. § 824(b)(1) (*emphasis added*).

⁸ See 16 U.S.C. § 824(d) ("Unless the Commission otherwise orders, no change shall be made by any public utility in any such rates, charges, classification, or service, or in any rule, regulation, or contract relating thereto, except after sixty days' notice to the Commission and to the public").

⁹ See *Detroit Edison Co. v. FERC*, 334 F.3d 48, 51 (D.C. Cir. 2003) (explaining that the Commission has jurisdiction "over all wholesale service," including wholesale transactions that occur over "local distribution" facilities); See also, *PJM Interconnection, L.L.C.*, 116 FERC ¶ 61,102 (July 31, 2006) at P 22. ("Because no wholesale transaction is

Honorable Kimberly D. Bose, Secretary
May 13, 2016
Page 4

the retail sales. The Commission noted: “[W]here the ‘distribution’ facilities have a dual use, *i.e.*, the facilities are used for both wholesale sales and retail sales, the Final Rule applies to interconnections to these facilities only for the purpose of making sales of electric energy for resale in interstate commerce.”¹⁰ The Commission bifurcates the use of the facility and applies its jurisdiction only to the applicable transaction, the wholesale sale. Here, the generator’s use of, and taking of service over, the distribution facilities does not diminish the Commission’s independent jurisdiction to regulate the generator’s sale of energy and related products in PJM’s organized wholesale markets.

This logic is consistently applied in other areas of Commission jurisdiction as well. For example, the Commission applied similar reasoning when it determined it has jurisdiction to require transmission service over non-jurisdictional local distribution facilities in *Tex-La Electric Cooperative of Texas, Inc.*¹¹ The Commission noted that it retained authority to order transmission service pursuant to section 211 of the FPA regardless of any local distribution function of the facilities involved and “. . . transmission *services* may encompass the use of *facilities* that in other contexts would be classified as distribution facilities.”¹² Similarly, in *Laguna Irrigation District*, the Commission noted that wholesale customers should be allowed the protection of section 210 of the FPA based merely on the label attached to the facilities to which they interconnect.¹³

Accordingly, since the WMPA addresses the terms and conditions necessary for the

being conducted on ComEd’s distribution facilities, we find there is no Commission-jurisdictional use of the facilities” Hence, a wholesale transaction would be a jurisdictional use.).

¹⁰ Order No. 2003 at P804; *Accord* Order No. 2003-C at P 53.

¹¹ *Tex-La Electric Cooperative of Texas, Inc.*, 67 FERC ¶ 61,019, *final order*, 69 FERC ¶ 61,269 (1994) (“*Tex-La Electric Cooperative*”); *See Laguna Irrigation District*, 95 FERC ¶ 61,305 (2001), *aff’d sub nom. Pacific Gas & Electric Co. v. FERC*, 44 Fed. Appx. 170 (9th Cir. 2002) (“*Laguna Irrigation*”).

¹² *Tex-La Electric Cooperative of Texas, Inc.*, 67 FERC ¶ at 61,056 n. 36 (emphasis in original).

¹³ *Laguna Irrigation, supra*.

Honorable Kimberly D. Bose, Secretary
May 13, 2016
Page 5

generator to make wholesale sales in the PJM markets, PJM applies the same reasoning as detailed above and believes that an agreement enabling such sales (the WMPA) similarly falls within the Commission's jurisdiction.

Should the Commission disagree and decide not to exercise its jurisdiction over the WMPA, PJM will, nonetheless, require execution of the WMPA by similarly-situated generators and transmission owners as a matter of contract. The matters addressed by the WMPA are essential to preserve the continued integrity of PJM's functions as a grid operator and market administrator; and, as such, are properly deemed reasonable conditions of entry, like other RTO membership requirements, for a generator electing to participate in PJM's voluntary markets.

III. THE WMPA APPLIES TO WHOLESALE SALES ONLY.

PJM submitted the WMPA for filing because the WMPA is a form of agreement not presently contained in either the PJM Open Access Transmission Tariff ("PJM Tariff") or the PJM Operating Agreement. The WMPA applies only to wholesale transactions and is not intended to govern the actual physical interconnection of a generating facility to the distribution system. Therefore, it is immaterial whether the WMPA concerns a new interconnection to a distribution system or a pre-existing interconnection on a distribution system where the pre-existing generator subsequently elects to participate in the PJM markets. The WMPA will be initiated for the purpose of facilitating the wholesale sale and not the interconnection. To date, generator market participants connecting to the distribution system have been receptive to the use of the WMPA as a means to facilitate future sales into the PJM markets and to support the state interconnection processes as well. Further, the WMPA allows a vehicle for PJM to examine the potential reliability impacts the interconnection may have on the grid.

Honorable Kimberly D. Bose, Secretary
May 13, 2016
Page 6

As the GSG Order directs,¹⁴ interconnection to the distribution system is not FERC jurisdictional until wholesale sales begin on the system. Hence, the PJM Tariff would not apply to govern the terms and conditions of the physical interconnection, including the attachment of facilities and terms of use and charges for distribution service needed to afford the generator access to the PJM Transmission System. Again, PJM's interest is to ensure sufficient visibility, and where necessary, control over generation that is participating as a Market Seller under the PJM Operating Agreement.¹⁵

IV. THE WMPA DIFFERS FROM THE ISA IN NUMEROUS IMPORTANT ASPECTS.

The WMPA is designed to have a similar format to the PJM Interconnection Service Agreement ("ISA") in order to provide a manageable and familiar document for the participants. Unlike the ISA, however, the WMPA does not address matters involving the actual physical interconnection of the generator to the distribution system or any terms, conditions or charges related to any service provided by the distribution system to the generator. The WMPA contains many provisions also typically found in an ISA that govern the relationship between the generator and PJM. These provisions establish reasonable and necessary standards and qualifications, such as revenue quality metering, both to enable the generator to participate as a Market Seller¹⁶ in PJM's market and to allow PJM's system operations the necessary visibility to the generator for reliability purposes. However, the WMPA is not an ISA and is not intended as a substitute for an interconnection agreement between the owners of the interconnecting physical facilities.

¹⁴ See GSG Order at P 14.

¹⁵ See Amended and Restated Operating Agreement of PJM Interconnection, L.L.C. ("PJM Operating Agreement"), Schedule 1.

¹⁶ See *Market Seller* defined in the PJM Operating Agreement at § 1.23.

Honorable Kimberly D. Bose, Secretary
May 13, 2016
Page 7

More specifically, the WMPA differs from the ISA in several key respects. First, the WMPA does not contain any reference to attachment facilities necessary for the interconnection. The WMPA also does not reference network upgrades for the interconnection to the distribution facility. In limited circumstances, the Feasibility Study and/or the System Impact Study may conclude that there is a significant impact to other jurisdictional interconnections that are located on the nearest transmission system, or a possible impact to facilities that are located on a nearby Commission-jurisdictional distribution facility. If this were the case, the interconnecting generator could be required to fund network upgrades on the corresponding jurisdictional systems only. In the event additional upgrades were needed, the WMPA contains proposed language concerning “Responsibility for Network or Local Upgrades” in Article 3 of the WMPA. At the discretion of the Parties, they may simply mark this section as “not applicable” or delete the section from the WMPA in its entirety when this contract language is inapplicable (as it will be in the majority of cases).

Generally, the WMPA does not contain security requirements (with the limited exception as explained above), or construction requirements. The WMPA also makes no reference to reactive power requirements and construction of transmission owner interconnection facilities. These are the key components of the ISA that are not included in the WMPA because these ISA components are not relevant to the wholesale transactions.

V. WAIVER AND EFFECTIVE DATE

PJM requests that the Commission grant any and all waivers of the Commission’s rules and regulations that are necessary for acceptance of this filing and the enclosed WMPA. Additionally, PJM requests a waiver of the Commission’s 60-day prior notice requirement to allow an effective date of January 5, 2015, for the WMPA, as set forth in § 1.1 thereof. Due to an

Honorable Kimberly D. Bose, Secretary
May 13, 2016
Page 8

inadvertent administrative error that took place during PJM personnel transitions, PJM is submitting this filing out of time and respectfully requests a waiver to the extent necessary to obtain Commission acceptance of this filing. Good cause exists because the Parties agreed to the proposed effective date, and the terms and conditions are consistent with other WMPAs filed with and accepted by the Commission. The Commission's provision of waiver will allow the Parties to move forward as soon as possible. In addition, no other customers will be adversely affected since the activities provided for under this WMPA will affect only the Parties. Moreover, no payments have been made pursuant to this agreement. Finally, this error occurred as part of a legacy issue, and PJM already implemented additional administrative procedures, including more detailed logs tracking the progress of service agreements from inception thereof to submission of same with the Commission, in an effort to avoid this type of administrative error in the future. The Commission's provision of waiver in this instance would be consistent with its practice of granting waiver when good cause exists.¹⁷

¹⁷ See, e.g., *PJM Interconnection, L.L.C.*, Docket No. ER08-873-000, Letter Order issued June 10, 2008 (Waiver granted to permit effective dates for multiple Interconnection Service Agreements ("ISAs") filed out of time); *PJM Interconnection, L.L.C.*, Docket No. ER03-233-000, Letter Order issued January 6, 2003 (Waiver granted to permit effective dates for multiple ISAs and Interim ISAs filed as much as two years after the requested effective dates); *PJM Interconnection, L.L.C.*, Docket No. ER02-2524-000, Letter Order issued September 27, 2002 (Waiver granted to permit June 3, 2002 effective date for ISA filed on August 30, 2002); *PJM Interconnection, L.L.C.*, Docket No. ER02-2522-000, Letter Order issued September 27, 2002 (Waiver granted to permit effective dates of March 19, 2002, May 16, 2002, and August 21, 2002 for ISAs filed on August 30, 2002); *PJM Interconnection, L.L.C.*, Docket No. ER02-2432-000, Letter Order issued October 3, 2002 (Waiver granted to permit effective dates of June 5, 2001 and May 6, 2002 for ISAs filed on August 7, 2002); *PJM Interconnection, L.L.C.*, Docket No. ER02-2373-000, Letter Order issued August 26, 2002 (Waiver granted to permit effective dates of March 19, 2002 and May 23, 2002 for ISAs filed on July 26, 2002); and *PJM Interconnection, L.L.C.*, Docket No. ER02-2255-000, Letter Order issued August 30, 2002 (Waiver granted to permit effective dates of August 27, 2001 and April 4, 2002 for ISAs filed on July 3, 2002).

Honorable Kimberly D. Bose, Secretary
May 13, 2016
Page 9

VI. DOCUMENTS ENCLOSED

PJM encloses the following:

1. This Transmittal Letter;
2. WMPA - Service Agreement No. 4461; and
3. Attachment A: Copy of sheet containing original signatures.

VII. SERVICE

Copies of this filing have been served upon CE and ACE at the addresses listed below, as well as on the state utility regulatory commissions within the PJM region.

VIII. CORRESPONDENCES AND COMMUNICATIONS

All notices, communications or correspondences addressed to PJM regarding this matter should be directed to, and PJM requests that the Secretary include on the Commission's official service list, the following:

Craig Glazer
Vice President–Federal Government Policy
PJM Interconnection, L.L.C.
1200 G Street, N.W, Suite 600
Washington, D.C. 20005
(202) 423-4743
craig.glazer@pjm.com

Jeanine S. Watson
Senior Counsel
PJM Interconnection, L.L.C.
2750 Monroe Blvd.
Audubon, PA 19403
(610) 666-4438
jeanine.watson@pjm.com

Respectfully submitted,



Craig Glazer
Vice President–Federal Government Policy
PJM Interconnection, L.L.C.
1200 G Street, N.W, Suite 600
Washington, D.C. 20005
(202) 423-4743
craig.glazer@pjm.com

Jeanine S. Watson
Senior Counsel
PJM Interconnection, L.L.C.
2750 Monroe Blvd.
Audubon, Pennsylvania 19403
(610) 666-4438
jeanine.watson@pjm.com

Honorable Kimberly D. Bose, Secretary

May 13, 2016

Page 10

cc: Community Energy Renewables, LLC
Three Radnor Corporate Center, Suite 300
100 Matsonford Road
Radnor, PA 19087
Attn: Mr. Eric Blank

Atlantic City Electric Company/Peppo Holdings, Inc.
Mail Stop #79NC58
401 Eagle Run Road
Newark, DE 19702
Attn: Manager, Interconnection & Arrangements

All State Utility Regulatory Commissions within the PJM Region

Service Agreement No. 4461

(PJM Queue #W4-027)

WHOLESALE MARKET PARTICIPATION AGREEMENT
Among
PJM INTERCONNECTION, L.L.C.
And
COMMUNITY ENERGY RENEWABLES, LLC
And
ATLANTIC CITY ELECTRIC COMPANY

Service Agreement No. 4461

WHOLESALE MARKET PARTICIPATION AGREEMENT

**By and Among
PJM Interconnection, L.L.C.
And
Community Energy Renewables, LLC
And
Atlantic City Electric Company
(PJM Queue Position #W4-027)**

This Wholesale Market Participation Agreement (“WMPA”) including the Specifications, and Schedules attached hereto and incorporated herein, is entered into in order to effectuate sales of energy and/or capacity into PJM’s wholesale markets, by and between PJM Interconnection, L.L.C., the Regional Transmission Organization for the PJM Region (“Transmission Provider”), Community Energy Renewables, LLC (“Wholesale Market Participant”) and Atlantic City Electric Company (“Transmission Owner” or “ACE”).

WITNESSETH

WHEREAS, Wholesale Market Participant is developing generation that it intends to use to engage in Wholesale Transactions in PJM’s markets and desires to maintain its proposed generation in the queue that PJM studies for potential reliability impacts to the Transmission System;

WHEREAS, Wholesale Market Participant is seeking to interconnect at a local distribution or sub-transmission facility, which at this time is not subject to FERC jurisdiction; and

WHEREAS, Wholesale Market Participant and Transmission Owner or its affiliate must enter into a separate two-party interconnection agreement (“Interconnection Agreement”) in order to address issues of physical interconnection and local charges that may be presented by the interconnection of Wholesale Market Participant’s generation to the distribution facility.

NOW, THEREFORE, in consideration of the mutual covenants herein contained, together with other good and valuable consideration, the receipt and sufficiency is hereby mutually acknowledged by Transmission Provider, Transmission Owner and Wholesale Market Participant and the parties agree to assume all of the rights and obligations consistent with the rights and obligations relating to Network Upgrades, Local Upgrades and metering requirements set forth in Part VI of the Tariff, as of the effective date of this WMPA, required for Wholesale Market Participant to make Wholesale Transactions in PJM’s markets. The Parties mutually covenant and agree as follows:

Article 1 – DEFINITIONS and OTHER DOCUMENTS

- 1.0 Defined Terms.** All capitalized terms herein shall have the meanings as set forth in the definitions of such terms as stated in Part I, Article 1 or Part VI of the PJM Open Access Transmission Tariff (“Tariff”), except Wholesale Market Participant which shall be defined in this WMPA as a participant in a Wholesale Transaction.
- 1.1 Effective Date.** This WMPA shall become effective on the date it is executed by all Parties, or, if this WMPA is filed with FERC unexecuted, upon the date specified by FERC. This WMPA shall terminate on such date as mutually agreed upon by the parties, unless earlier terminated consistent with Section 1 in Attachment O, Appendix 2, Part VI of the Tariff.
- 1.2 Assumption of Tariff Obligations.** Wholesale Market Participant agrees to abide by all rules and procedures pertaining to generation and transmission in the PJM Region, including but not limited to the rules and procedures concerning the dispatch of generation or scheduling transmission set forth in the Tariff, the Operating Agreement and the PJM Manuals.
- 1.3 Incorporation Of Other Documents.** All portions of the Tariff and the Operating Agreement pertinent to the subject matter of this WMPA and not otherwise made a part hereof are hereby incorporated herein and made a part hereof.

Article 2 - NOTICES and MISCELLANEOUS

- 2.0 Notices.** Any notice, demand or request required or permitted to be given by any Party to another and any instrument required or permitted to be tendered or delivered by any Party in writing to another may be so given, tendered or delivered by recognized national courier or by depositing the same with the United States Postal Service, with postage prepaid for delivery by certified or registered mail addressed to the Party, or by personal delivery to the Party, at the address specified below. Such notices, if agreed to by the Parties, may be made via electronic means, with e-mail confirmation of delivery.

Transmission Provider:

PJM Interconnection, L.L.C.
2750 Monroe Blvd.
Audubon, PA 19403-2497

Wholesale Market Participant:

Community Energy Renewables, LLC
Three Radnor Corporate Center, Suite 300
100 Matsonford Road
Radnor, PA 19087

Attn: Mr. Eric Blank
Phone: 215-740-8355
Email: interconnection@communityenergyinc.com

Transmission Owner:

Atlantic City Electric Company/ Pepco Holdings, Inc (PHI)
Mail Stop #79NC58
P.O. Box 9239 (US Mail) 401 Eagle Run Road (overnight mail)
Newark, DE 19714-9239 (US Mail) Newark, DE 19702 (overnight)
Phone: (302) 283-5734
Email: Interconnections@Pepcoholdings.com
Attn: Manager, Interconnection & Arrangements

- 2.1 Construction With Other Parts Of The Tariff.** This WMPA shall not be construed as an application for service under Part II or Part III of the Tariff.
- 2.2 Warranty for Facilities Study.** In analyzing and preparing the Generation Interconnection Facilities Study, and in designing and constructing the Local Upgrades and/or Network Upgrades described in Part II of the Tariff and in the Specifications attached to this WMPA, Transmission Provider, the Transmission Owner(s), and any other subcontractors employed by Transmission Provider have had to, and shall have to, rely on information provided by Wholesale Market Participant and possibly by third parties and may not have control over the accuracy of such information. Accordingly, NEITHER TRANSMISSION PROVIDER, THE TRANSMISSION OWNER(s), NOR ANY OTHER SUBCONTRACTORS EMPLOYED BY TRANSMISSION PROVIDER OR TRANSMISSION OWNER MAKES ANY WARRANTIES, EXPRESS OR IMPLIED, WHETHER ARISING BY OPERATION OF LAW, COURSE OF PERFORMANCE OR DEALING, CUSTOM, USAGE IN THE TRADE OR PROFESSION, OR OTHERWISE, INCLUDING WITHOUT LIMITATION IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, WITH REGARD TO THE ACCURACY, CONTENT, OR CONCLUSIONS OF THE FACILITIES STUDY OR THE SYSTEM IMPACT STUDY IF A FACILITIES STUDY WAS NOT REQUIRED OR OF THE LOCAL UPGRADES AND/OR THE NETWORK UPGRADES, PROVIDED, HOWEVER, that Transmission Provider warrants that the Transmission Owner Facilities described in the Specifications will be designed and constructed (to the extent that Transmission Owner is responsible for design and construction thereof) and operated in accordance with Good Utility Practice, as such term is defined in the Operating Agreement. Wholesale Market Participant acknowledges that it has not relied on any representations or warranties not specifically set forth herein and that no such representations or warranties have formed the basis of its bargain hereunder.
- 2.3 Waiver.** No waiver by any party of one or more defaults by the other in performance of any of the provisions of this WMPA shall operate or be construed as a waiver of any other or further default or defaults, whether of a like or different character.

- 2.4 Amendment.** This WMPA or any part thereof, may not be amended, modified, or waived other than by a written document signed by all parties hereto.
- 2.5 Addendum of Wholesale Market Participant’s Agreement to Conform with IRS Safe Harbor Provisions for Non-Taxable Status.** To the extent required, in accordance with Section 24.1 in Attachment O, Appendix 2 in Part VI of the Tariff, Schedule E to this WMPA shall set forth the Wholesale Market Participant’s agreement to conform with the IRS safe harbor provisions for non-taxable status.

ARTICLE 3 – Responsibility for Network or Local Upgrades

- 3.0 Security for Network or Local Upgrades.** Consistent with Section 212.4 in Part VI of the Tariff, Wholesale Market Participant, on or before the effective date of this WMPA, shall provide the Transmission Provider (for the benefit of the Transmission Owner) with a letter of credit from an agreed provider or other form of security reasonably acceptable to the Transmission Provider and that names the Transmission Provider as beneficiary (“Security”) in the amount of **\$0**. This amount represents the sum of the estimated Costs, determined consistent with Section 217 in Part VI of the Tariff, of (i) the Local Upgrades and/or Network Upgrades described in Section 3.4 of this WMPA less any Costs already paid by the Wholesale Market Participant. Should Wholesale Market Participant fail to provide Security in the amount or form required in the first sentence of this Section, this WMPA shall be terminated. Wholesale Market Participant acknowledges that its ultimate cost responsibility consistent with Section 217 in Part VI of the Tariff will be based upon the actual Costs of the facilities described in the Specifications to this WMPA, whether greater or lesser than the amount of the Security provided under this Section.
- 3.1 Project Specific Milestones.** During the term of this WMPA, Wholesale Market Participant shall ensure that it meets each of the following milestones:
- 3.1.1 Substantial Site work completed.** On or before **September 30, 2017**, Wholesale Market Participant must demonstrate completion of at least 20% of project site construction.
- 3.1.2 Commercial Operation.** (i) On or before **June 1, 2018**, Wholesale Market Participant must demonstrate commercial operation of **all** generating units; (ii) On or before **June 1, 2018**, Wholesale Market Participant must demonstrate commercial sale or use of energy and, if applicable obtain capacity qualification consistent with the requirements of the Reliability Assurance Agreement Among Load Serving Entities in the PJM Region.
- 3.1.3 Documentation.** Within one (1) month following commercial operation of generating unit(s), Wholesale Market Participant must provide certified documentation demonstrating that “as-built” Participant Facility are consistent with applicable PJM studies and agreements. Wholesale Market Participant must also provide PJM with “as-built” electrical modeling data or confirm that previously submitted data remains valid.

3.1.4 Interconnection Agreement. On or before **December 15, 2015**, Wholesale Market Participant must enter into an Interconnection Agreement with the Interconnected Transmission Owner in order to effectuate the WMPA.

Wholesale Market Participant shall demonstrate the occurrence of each of the foregoing milestones to Transmission Provider's reasonable satisfaction. Transmission Provider may reasonably extend any such milestone dates, in the event of delays that Wholesale Market Participant (i) did not cause and (ii) could not have remedied through the exercise of due diligence.

If (i) the Wholesale Market Participant suspends work pursuant to a suspension provision contained in an interconnection and/or construction agreement with the Interconnected Transmission Owner or (ii) the Interconnected Transmission Owner extends the date by which Wholesale Market Participant must enter into an interconnection agreement relative to this WMPA, and (iii) the Wholesale Market Participant has not made a wholesale sale under this WMPA, the Wholesale Market Participant may suspend this WMPA by notifying the Transmission Provider and the Interconnected Transmission Owner in writing that it wishes to suspend this WMPA, with the condition that, notwithstanding such suspension, the Transmission System shall be left in a safe and reliable condition in accordance with Good Utility Practice and Transmission Provider's safety and reliability criteria. Wholesale Market Participant's notice of suspension shall include an estimated duration of the suspension period and other information related to the suspension. Pursuant to this section 3.1, Wholesale Market Participant may request one or more suspensions of work under this WMPA for a cumulative period of up to a maximum of three years. If, however, the suspension will result in a Material Modification as defined in Part I, Section 1.18A.02 of the Tariff, then such suspension period shall be no greater than one (1) year. If the Wholesale Market Participant suspends this WMPA pursuant to this Section 3.1 and has not provided written notice that it will exit such suspension on or before the expiration of the suspension period described herein, this WMPA shall be deemed terminated as of the end of such suspension period. The suspension time shall begin on the date the suspension is requested or on the date of the Wholesale Market Participant's written notice of suspension to Transmission Provider, if no effective date was specified. All milestone dates stated in this Section 3.1 shall be deemed to be extended coextensively with any suspension period permitted pursuant to this provision.

IN WITNESS WHEREOF, Transmission Provider, Wholesale Market Participant and Transmission Owner have caused this WMPA to be executed by their respective authorized officials.

(PJM Queue #W4-027)

Transmission Provider: PJM Interconnection, L.L.C.

By: /s/ David M. Egan Manager, Interconnection Planning 1/5/15
Name Title Date

Printed name of signer: David M. Egan

Wholesale Market Participant: Community Energy Renewables, LLC

By: /s/ Thomas J. Tuffey Manager 4 Dec 2014
Name Title Date

Printed name of signer: Thomas J. Tuffey

Transmission Owner: Atlantic City Electric Company

By: /s/ Scott C. Razze Manager, Interconnection and Arrangements 12/31/14
Name Title Date

Printed name of signer: Scott C. Razze

**SPECIFICATIONS FOR
WHOLESALE MARKET PARTICIPATION AGREEMENT
By and Among
PJM INTERCONNECTION, L.L.C.
And
COMMUNITY ENERGY RENEWABLES, LLC
And
ATLANTIC CITY ELECTRIC COMPANY
(PJM Queue Position # W4-027)**

1.0 Description of generating unit(s) (the “Participant Facility”) to be used for the provision of wholesale sales into the PJM markets:

a. Name of Participant Facility:

Minotola 2 Solar Facility

b. Location of Participant Facility:

Vine Road, Buena Vista Twp.
Atlantic County, New Jersey

c. Size in megawatts of Participant Facility:

Maximum Facility Output of 7.9 MW

d. Description of the equipment configuration:

A ground mounted, inverter based, solar photovoltaic generating facility consisting of solar arrays and a 12 kV high side collector system.

2.0 Rights for Generation Wholesale Market Participant

2.1 Capacity Interconnection Rights:

Consistent with the applicable terms of the Tariff, the Wholesale Market Participant shall have Capacity Interconnection Rights at the point(s) of interconnection specified in Schedule A of this Wholesale Market Participant Agreement in the amount of **3 MW**; provided however, nothing in this WMPA provides any rights with regard to the use of distribution facilities.

To the extent that any portion of the Participant Facility described in Section 1.0 is not a Capacity Resource with Capacity Interconnection Rights, such portion of the Participant Facility shall be an Energy Resource. Pursuant to this WMPA, the Wholesale Market Participant may sell energy into PJM's markets in an amount equal to the Participant Facility's Maximum Facility Output indicated in Section 1.0c of the Specifications for this WMPA. PJM reserves the right to limit injections in the event reliability would be affected by output greater than such quantity.

3.0 Ownership and Location of Metering Equipment. The metering equipment to be constructed, the capability of the metering equipment to be constructed, and the ownership thereof, as required for the Wholesale Transactions shall be identified on the attached Schedule B to this WMPA, and provided consistent with the PJM manuals.

SCHEDULES:

- **SCHEDULE A - SINGLE-LINE DIAGRAM (Showing point of interconnection)**
- **SCHEDULE B - LIST OF METERING EQUIPMENT**
- **SCHEDULE C - LIST OF LOCAL/NETWORK UPGRADES**
- **SCHEDULE D - APPLICABLE TECHNICAL REQUIREMENTS AND STANDARDS**
- **SCHEDULE E - WHOLESALE MARKET PARTICIPANT AGREEMENT TO CONFORM WITH IRS SAFE HARBOR PROVISIONS FOR NON-TAXABLE STATUS**
- **SCHEDULE F –SCHEDULE OF NON-STANDARD TERMS & CONDITIONS**


SCHEDULE A


SINGLE-LINE DIAGRAM

W4 – 027

Minotola 138/12 kV Sub

PV Solar Generator 7.9 MW

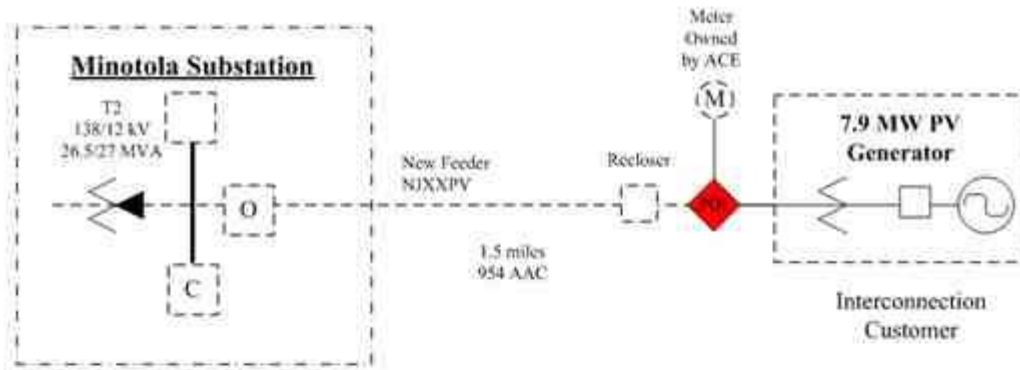

 Point of Interconnection

SCHEDULE B

LIST OF METERING EQUIPMENT

The Wholesale Market Participant will be required to install telemetry equipment at the Point of Interconnection identified in Schedule A to provide real-time telemetry data to PJM in accordance with the requirements listed in PJM Manuals 01, 14A, 14B and 14D. Protective relaying and metering design and installation must comply with the Transmission Owner Standards identified in Schedule D of this WMPA.

The Wholesale Market Participant has not exercised its option to install, own, operate, and maintain the revenue meter. Therefore, Transmission Owner will install, own, operate and maintain, at the Wholesale Market Participant's cost, the revenue meter located as depicted in Schedule A of this WMPA. The Transmission Owner revenue meter will be the official meter and must be the source for reporting generation output to PJM. A billing quality 12 kV metering instrument transformer will be installed to serve the new meter position. This meter will be used by the Wholesale Market Participant to provide revenue metering data to PJM. The Wholesale Market Participant is responsible for installing telemetry equipment necessary to obtain the revenue meter data and submit the data to PJM.

Transmission Owner will provide a multifunction solid state meter (Class 20, 120V, 60Hz, 0.1%) that will record four channels of load profile data (imported and exported MWH and MVARH) which will then be interrogated remotely via Transmission Owner's translation and telecommunications systems.

The Wholesale Market Participant will be required to make provisions for a voice quality phone line within approximately 3 feet of each Transmission Owner metering position to facilitate remote interrogation and data collection.

It is the Wholesale Market Participant's responsibility to send the data that PJM and the Transmission Owner require directly to PJM. The Wholesale Market Participant will grant permission for PJM to send the Transmission Owner the following telemetry that the Wholesale Market Participant sends to PJM: real-time MW, MVAR, volts, amps, status, and interval MWH and MVARH.

SCHEDULE C
LIST OF LOCAL/NETWORK UPGRADES

Not Required.

SCHEDULE D

APPLICABLE TECHNICAL REQUIREMENTS AND STANDARDS

“Pepco Holdings, Inc. (PHI) Power Delivery Technical Considerations Covering Parallel Operations of Customer Owned Generation of One (1) Megawatt or Greater And Interconnected with the PHI Power Delivery System”, dated April 20, 2011.

“Operations and Modifications Requirements of Atlantic City Electric Company, Delmarva Power & Light Company, Potomac Electric Power Company (Pepco) – Companies of Pepco Holdings, Inc.”, dated October 10, 2011.

The above Applicable Technical Requirements and Standards can be found at:

<http://www.pjm.com/~media/planning/plan-standards/private-ace/phi-technical-considerations-for-generation-parallel-operations.ashx>

<http://www.pjm.com/~media/planning/plan-standards/private-dpl/phi-operations-and-modifications-requirements.ashx>

SCHEDULE E

WHOLESALE MARKET PARTICIPANT'S AGREEMENT TO CONFORM WITH IRS SAFE HARBOR PROVISIONS FOR NON-TAXABLE STATUS

As provided in Section 24.1 in Attachment O, Appendix 2 in Part VI of the Tariff and subject to the requirements thereof, Wholesale Market Participant represents that it meets all qualifications and requirements as set forth in Section 118(a) and 118(b) of the Internal Revenue Code of 1986, as amended and interpreted by Notice 88-129, 1988-2 C.B. 541, and as amplified and modified in Notices 90-60, 1990-2 C.B. 345, and 2001-82, 2001-2 C.B. 619 (the "IRS Notices"). Wholesale Market Participant agrees to conform with all requirements of the safe harbor provisions specified in the IRS Notices, as they may be amended, as required to confer non-taxable status on some or all of the transfer of property, including money, by Wholesale Market Participant to Transmission Owner with respect to the payment of the Costs of construction and installation of the Transmission Owner Interconnection Facilities specified in this WMPA.

Nothing in Wholesale Market Participant's agreement pursuant to this Schedule E shall change the indemnification obligations under Section 24.2 in Attachment O, Appendix 2 in Part VI of the Tariff.

SCHEDULE F
SCHEDULE OF NON-STANDARD TERMS & CONDITIONS

Not Required.

ATTACHMENT A

**Copy of Original Signatures
Service Agreement No. 4461**

IN WITNESS WHEREOF, Transmission Provider, Wholesale Market Participant and Transmission Owner have caused this WMPA to be executed by their respective authorized officials.

(PJM Queue #W4-027)

Transmission Provider: PJM Interconnection, L.L.C.

By: David M. Egan David M. Egan 1/5/15
Name Title Date

Printed name of signer: _____

Wholesale Market Participant: Community Energy Renewables, LLC

By: Thomas J. Tuffey manager 9 Dec 2014
Name Title Date

Printed name of signer: Thomas J. Tuffey

Transmission Owner: Atlantic City Electric Company

By: Scott C. Razze Manager, Interconnection and Arrangements 12/31/14
Name Title Date

Printed name of signer: Scott C. Razze

FERC rendition of the electronically filed tariff records in Docket No. ER16-01694-000

Filing Data:

CID: C000030

Filing Title: Original WMPA SA No. 4461, Queue No. W4-027

Company Filing Identifier: 2095

Type of Filing Code: 10

Associated Filing Identifier:

Tariff Title: PJM Service Agreements Tariff

Tariff ID: 40

Payment Confirmation:

Suspension Motion:

Tariff Record Data:

Record Content Description, Tariff Record Title, Record Version Number, Option Code:

PJM SA No. 4461, PJM SA No. 4461 among PJM, Community Energy and AEC, 0.0.0, A

Record Narrative Name: Executed Wholesale Market Participation Agreement No. 4461 among PJM, Community Energy Renewables, LLC and Atlantic City Electric Company.

Tariff Record ID: 1365

Tariff Record Collation Value: 558623910 Tariff Record Parent Identifier: 0

Proposed Date: 2015-01-05

Priority Order: 500

Record Change Type: NEW

Record Content Type: 1

Associated Filing Identifier:

Service Agreement No. 4461

(PJM Queue #W4-027)

WHOLESALE MARKET PARTICIPATION AGREEMENT

Among

PJM INTERCONNECTION, L.L.C.

And

COMMUNITY ENERGY RENEWABLES, LLC

And

ATLANTIC CITY ELECTRIC COMPANY

Service Agreement No. 4461

WHOLESALE MARKET PARTICIPATION AGREEMENT

**By and Among
PJM Interconnection, L.L.C.
And
Community Energy Renewables, LLC
And
Atlantic City Electric Company
(PJM Queue Position #W4-027)**

This Wholesale Market Participation Agreement (“WMPA”) including the Specifications, and Schedules attached hereto and incorporated herein, is entered into in order to effectuate sales of energy and/or capacity into PJM’s wholesale markets, by and between PJM Interconnection, L.L.C., the Regional Transmission Organization for the PJM Region (“Transmission Provider”), Community Energy Renewables, LLC (“Wholesale Market Participant”) and Atlantic City Electric Company (“Transmission Owner” or “ACE”).

WITNESSETH

WHEREAS, Wholesale Market Participant is developing generation that it intends to use to engage in Wholesale Transactions in PJM’s markets and desires to maintain its proposed generation in the queue that PJM studies for potential reliability impacts to the Transmission System;

WHEREAS, Wholesale Market Participant is seeking to interconnect at a local distribution or sub-transmission facility, which at this time is not subject to FERC jurisdiction; and

WHEREAS, Wholesale Market Participant and Transmission Owner or its affiliate must enter into a separate two-party interconnection agreement (“Interconnection Agreement”) in order to address issues of physical interconnection and local charges that may be presented by the interconnection of Wholesale Market Participant’s generation to the distribution facility.

NOW, THEREFORE, in consideration of the mutual covenants herein contained, together with other good and valuable consideration, the receipt and sufficiency is hereby mutually acknowledged by Transmission Provider, Transmission Owner and Wholesale Market Participant and the parties agree to assume all of the rights and obligations consistent with the rights and obligations relating to Network Upgrades, Local Upgrades and metering requirements set forth in Part VI of the Tariff, as of the effective date of this

WMPA, required for Wholesale Market Participant to make Wholesale Transactions in PJM's markets. The Parties mutually covenant and agree as follows:

Article 1 – DEFINITIONS and OTHER DOCUMENTS

- 1.0 Defined Terms.** All capitalized terms herein shall have the meanings as set forth in the definitions of such terms as stated in Part I, Article 1 or Part VI of the PJM Open Access Transmission Tariff (“Tariff”), except Wholesale Market Participant which shall be defined in this WMPA as a participant in a Wholesale Transaction.
- 1.1 Effective Date.** This WMPA shall become effective on the date it is executed by all Parties, or, if this WMPA is filed with FERC unexecuted, upon the date specified by FERC. This WMPA shall terminate on such date as mutually agreed upon by the parties, unless earlier terminated consistent with Section 1 in Attachment O, Appendix 2, Part VI of the Tariff.
- 1.2 Assumption of Tariff Obligations.** Wholesale Market Participant agrees to abide by all rules and procedures pertaining to generation and transmission in the PJM Region, including but not limited to the rules and procedures concerning the dispatch of generation or scheduling transmission set forth in the Tariff, the Operating Agreement and the PJM Manuals.
- 1.3 Incorporation Of Other Documents.** All portions of the Tariff and the Operating Agreement pertinent to the subject matter of this WMPA and not otherwise made a part hereof are hereby incorporated herein and made a part hereof.

Article 2 - NOTICES and MISCELLANEOUS

- 2.0 Notices.** Any notice, demand or request required or permitted to be given by any Party to another and any instrument required or permitted to be tendered or delivered by any Party in writing to another may be so given, tendered or delivered by recognized national courier or by depositing the same with the United States Postal Service, with postage prepaid for delivery by certified or registered mail addressed to the Party, or by personal delivery to the Party, at the address specified below. Such notices, if agreed to by the Parties, may be made via electronic means, with e-mail confirmation of delivery.

Transmission Provider:

PJM Interconnection, L.L.C.
2750 Monroe Blvd.
Audubon, PA 19403-2497

Wholesale Market Participant:

Community Energy Renewables, LLC
Three Radnor Corporate Center, Suite 300
100 Matsonford Road
Radnor, PA 19087
Attn: Mr. Eric Blank
Phone: 215-740-8355
Email: interconnection@communityenergyinc.com

Transmission Owner:

Atlantic City Electric Company/ Pepco Holdings, Inc (PHI)
Mail Stop #79NC58
P.O. Box 9239 (US Mail) 401 Eagle Run Road (overnight mail)
Newark, DE 19714-9239 (US Mail) Newark, DE 19702 (overnight)
Phone: (302) 283-5734
Email: Interconnections@Pepcoholdings.com
Attn: Manager, Interconnection & Arrangements

- 2.1 Construction With Other Parts Of The Tariff.** This WMPA shall not be construed as an application for service under Part II or Part III of the Tariff.
- 2.2 Warranty for Facilities Study.** In analyzing and preparing the Generation Interconnection Facilities Study, and in designing and constructing the Local Upgrades and/or Network Upgrades described in Part II of the Tariff and in the Specifications attached to this WMPA, Transmission Provider, the Transmission Owner(s), and any other subcontractors employed by Transmission Provider have had to, and shall have to, rely on information provided by Wholesale Market Participant and possibly by third parties and may not have control over the accuracy of such information. Accordingly, NEITHER TRANSMISSION PROVIDER, THE TRANSMISSION OWNER(s), NOR ANY OTHER SUBCONTRACTORS EMPLOYED BY TRANSMISSION PROVIDER OR TRANSMISSION OWNER MAKES ANY WARRANTIES, EXPRESS OR IMPLIED, WHETHER ARISING BY OPERATION OF LAW, COURSE OF PERFORMANCE OR DEALING, CUSTOM, USAGE IN THE TRADE OR PROFESSION, OR OTHERWISE, INCLUDING WITHOUT LIMITATION IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, WITH REGARD TO THE ACCURACY, CONTENT, OR CONCLUSIONS OF THE FACILITIES STUDY OR THE SYSTEM IMPACT STUDY IF A FACILITIES STUDY WAS NOT REQUIRED OR OF THE LOCAL UPGRADES AND/OR THE NETWORK UPGRADES, PROVIDED, HOWEVER, that Transmission Provider warrants that the Transmission Owner Facilities described in the Specifications will be designed and constructed (to the extent that Transmission Owner is responsible for design and construction thereof) and operated in accordance with Good Utility Practice, as such term is defined in the Operating Agreement. Wholesale Market Participant acknowledges that it has not relied on any representations or warranties not specifically set forth herein and that no such representations or warranties have formed the basis of its bargain hereunder.

- 2.3 Waiver.** No waiver by any party of one or more defaults by the other in performance of any of the provisions of this WMPA shall operate or be construed as a waiver of any other or further default or defaults, whether of a like or different character.
- 2.4 Amendment.** This WMPA or any part thereof, may not be amended, modified, or waived other than by a written document signed by all parties hereto.
- 2.5 Addendum of Wholesale Market Participant's Agreement to Conform with IRS Safe Harbor Provisions for Non-Taxable Status.** To the extent required, in accordance with Section 24.1 in Attachment O, Appendix 2 in Part VI of the Tariff, Schedule E to this WMPA shall set forth the Wholesale Market Participant's agreement to conform with the IRS safe harbor provisions for non-taxable status.

ARTICLE 3 – Responsibility for Network or Local Upgrades

- 3.0 Security for Network or Local Upgrades.** Consistent with Section 212.4 in Part VI of the Tariff, Wholesale Market Participant, on or before the effective date of this WMPA, shall provide the Transmission Provider (for the benefit of the Transmission Owner) with a letter of credit from an agreed provider or other form of security reasonably acceptable to the Transmission Provider and that names the Transmission Provider as beneficiary (“Security”) in the amount of **\$0**. This amount represents the sum of the estimated Costs, determined consistent with Section 217 in Part VI of the Tariff, of (i) the Local Upgrades and/or Network Upgrades described in Section 3.4 of this WMPA less any Costs already paid by the Wholesale Market Participant. Should Wholesale Market Participant fail to provide Security in the amount or form required in the first sentence of this Section, this WMPA shall be terminated. Wholesale Market Participant acknowledges that its ultimate cost responsibility consistent with Section 217 in Part VI of the Tariff will be based upon the actual Costs of the facilities described in the Specifications to this WMPA, whether greater or lesser than the amount of the Security provided under this Section.
- 3.1 Project Specific Milestones.** During the term of this WMPA, Wholesale Market Participant shall ensure that it meets each of the following milestones:
- 3.1.1 Substantial Site work completed.** On or before **September 30, 2017**, Wholesale Market Participant must demonstrate completion of at least 20% of project site construction.
- 3.1.2 Commercial Operation.** (i) On or before **June 1, 2018**, Wholesale Market Participant must demonstrate commercial operation of **all** generating units; (ii) On or before **June 1, 2018**, Wholesale Market Participant must demonstrate commercial sale or use of energy and, if applicable obtain capacity qualification consistent with the requirements of the Reliability Assurance Agreement Among Load Serving Entities in the PJM Region.

3.1.3 Documentation. Within one (1) month following commercial operation of generating unit(s), Wholesale Market Participant must provide certified documentation demonstrating that “as-built” Participant Facility are consistent with applicable PJM studies and agreements. Wholesale Market Participant must also provide PJM with “as-built” electrical modeling data or confirm that previously submitted data remains valid.

3.1.4 Interconnection Agreement. On or before **December 15, 2015**, Wholesale Market Participant must enter into an Interconnection Agreement with the Interconnected Transmission Owner in order to effectuate the WMPA.

Wholesale Market Participant shall demonstrate the occurrence of each of the foregoing milestones to Transmission Provider’s reasonable satisfaction. Transmission Provider may reasonably extend any such milestone dates, in the event of delays that Wholesale Market Participant (i) did not cause and (ii) could not have remedied through the exercise of due diligence.

If (i) the Wholesale Market Participant suspends work pursuant to a suspension provision contained in an interconnection and/or construction agreement with the Interconnected Transmission Owner or (ii) the Interconnected Transmission Owner extends the date by which Wholesale Market Participant must enter into an interconnection agreement relative to this WMPA, and (iii) the Wholesale Market Participant has not made a wholesale sale under this WMPA, the Wholesale Market Participant may suspend this WMPA by notifying the Transmission Provider and the Interconnected Transmission Owner in writing that it wishes to suspend this WMPA, with the condition that, notwithstanding such suspension, the Transmission System shall be left in a safe and reliable condition in accordance with Good Utility Practice and Transmission Provider’s safety and reliability criteria. Wholesale Market Participant’s notice of suspension shall include an estimated duration of the suspension period and other information related to the suspension. Pursuant to this section 3.1, Wholesale Market Participant may request one or more suspensions of work under this WMPA for a cumulative period of up to a maximum of three years. If, however, the suspension will result in a Material Modification as defined in Part I, Section 1.18A.02 of the Tariff, then such suspension period shall be no greater than one (1) year. If the Wholesale Market Participant suspends this WMPA pursuant to this Section 3.1 and has not provided written notice that it will exit such suspension on or before the expiration of the suspension period described herein, this WMPA shall be deemed terminated as of the end of such suspension period. The suspension time shall begin on the date the suspension is requested or on the date of the Wholesale Market Participant’s written notice of suspension to Transmission Provider, if no effective date was specified. All milestone dates stated in this Section 3.1 shall be deemed to be extended coextensively with any suspension period permitted pursuant to this provision.

IN WITNESS WHEREOF, Transmission Provider, Wholesale Market Participant and Transmission Owner have caused this WMPA to be executed by their respective authorized officials.

(PJM Queue #W4-027)

Transmission Provider: PJM Interconnection, L.L.C.

By: /s/ David M. Egan Manager, Interconnection Planning 1/5/15
Name Title Date

Printed name of signer: David M. Egan

Wholesale Market Participant: Community Energy Renewables, LLC

By: /s/ Thomas J. Tuffey Manager 4 Dec 2014
Name Title Date

Printed name of signer: Thomas J. Tuffey

Transmission Owner: Atlantic City Electric Company

By: /s/ Scott C. Razze Manager, Interconnection and Arrangements 12/31/14
Name Title Date

Printed name of signer: Scott C. Razze

**SPECIFICATIONS FOR
WHOLESALE MARKET PARTICIPATION AGREEMENT**

**By and Among
PJM INTERCONNECTION, L.L.C.**

**And
COMMUNITY ENERGY RENEWABLES, LLC**

**And
ATLANTIC CITY ELECTRIC COMPANY
(PJM Queue Position # W4-027)**

1.0 Description of generating unit(s) (the “Participant Facility”) to be used for the provision of wholesale sales into the PJM markets:

a. Name of Participant Facility:

Minotola 2 Solar Facility

b. Location of Participant Facility:

Vine Road, Buena Vista Twp.
Atlantic County, New Jersey

c. Size in megawatts of Participant Facility:

Maximum Facility Output of 7.9 MW

d. Description of the equipment configuration:

A ground mounted, inverter based, solar photovoltaic generating facility consisting of solar arrays and a 12 kV high side collector system.

2.0 Rights for Generation Wholesale Market Participant

2.1 Capacity Interconnection Rights:

Consistent with the applicable terms of the Tariff, the Wholesale Market Participant shall have Capacity Interconnection Rights at the point(s) of interconnection specified in Schedule A of this Wholesale Market Participant Agreement in the amount of **3 MW**; provided however, nothing in this WMPA provides any rights with regard to the use of distribution facilities.

To the extent that any portion of the Participant Facility described in Section 1.0 is not a Capacity Resource with Capacity Interconnection Rights, such portion of the Participant Facility shall be an Energy Resource. Pursuant to this WMPA, the Wholesale Market Participant may sell energy into PJM's markets in an amount equal to the Participant Facility's Maximum Facility Output indicated in Section 1.0c of the Specifications for this WMPA. PJM reserves the right to limit injections in the event reliability would be affected by output greater than such quantity.

3.0 Ownership and Location of Metering Equipment. The metering equipment to be constructed, the capability of the metering equipment to be constructed, and the ownership thereof, as required for the Wholesale Transactions shall be identified on the attached Schedule B to this WMPA, and provided consistent with the PJM manuals.


SCHEDULES:


- **SCHEDULE A - SINGLE-LINE DIAGRAM (Showing point of interconnection)**
- **SCHEDULE B - LIST OF METERING EQUIPMENT**
- **SCHEDULE C - LIST OF LOCAL/NETWORK UPGRADES**
- **SCHEDULE D - APPLICABLE TECHNICAL REQUIREMENTS AND STANDARDS**
- **SCHEDULE E - WHOLESALE MARKET PARTICIPANT AGREEMENT TO CONFORM WITH IRS SAFE HARBOR PROVISIONS FOR NON-TAXABLE STATUS**
- **SCHEDULE F –SCHEDULE OF NON-STANDARD TERMS & CONDITIONS**

SCHEDULE A

SINGLE-LINE DIAGRAM

W4 – 027
Minotola 138/12 kV Sub
PV Solar Generator 7.9 MW

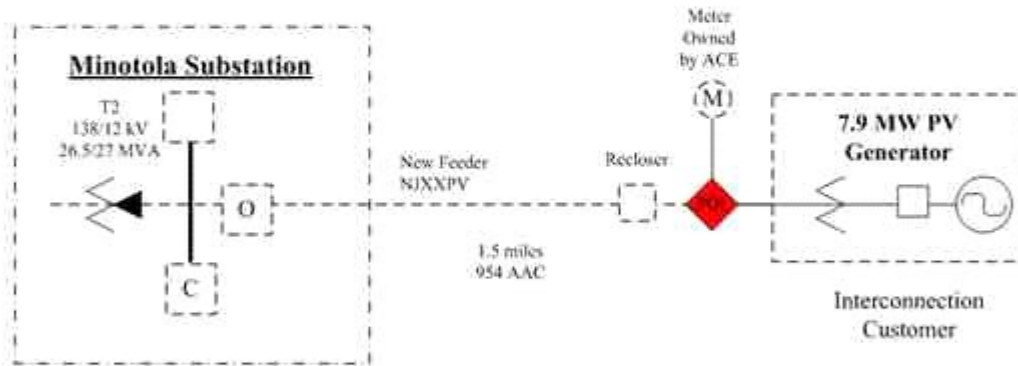

 Point of Interconnection

SCHEDULE B

LIST OF METERING EQUIPMENT

The Wholesale Market Participant will be required to install telemetry equipment at the Point of Interconnection identified in Schedule A to provide real-time telemetry data to PJM in accordance with the requirements listed in PJM Manuals 01, 14A, 14B and 14D. Protective relaying and metering design and installation must comply with the Transmission Owner Standards identified in Schedule D of this WMPA.

The Wholesale Market Participant has not exercised its option to install, own, operate, and maintain the revenue meter. Therefore, Transmission Owner will install, own, operate and maintain, at the Wholesale Market Participant's cost, the revenue meter located as depicted in Schedule A of this WMPA. The Transmission Owner revenue meter will be the official meter and must be the source for reporting generation output to PJM. A billing quality 12 kV metering instrument transformer will be installed to serve the new meter position. This meter will be used by the Wholesale Market Participant to provide revenue metering data to PJM. The Wholesale Market Participant is responsible for installing telemetry equipment necessary to obtain the revenue meter data and submit the data to PJM.

Transmission Owner will provide a multifunction solid state meter (Class 20, 120V, 60Hz, 0.1%) that will record four channels of load profile data (imported and exported MWH and MVARH) which will then be interrogated remotely via Transmission Owner's translation and telecommunications systems.

The Wholesale Market Participant will be required to make provisions for a voice quality phone line within approximately 3 feet of each Transmission Owner metering position to facilitate remote interrogation and data collection.

It is the Wholesale Market Participant's responsibility to send the data that PJM and the Transmission Owner require directly to PJM. The Wholesale Market Participant will grant permission for PJM to send the Transmission Owner the following telemetry that the Wholesale Market Participant sends to PJM: real-time MW, MVAR, volts, amps, status, and interval MWH and MVARH.

SCHEDULE C

LIST OF LOCAL/NETWORK UPGRADES

Not Required.

SCHEDULE D

APPLICABLE TECHNICAL REQUIREMENTS AND STANDARDS

“Pepco Holdings, Inc. (PHI) Power Delivery Technical Considerations Covering Parallel Operations of Customer Owned Generation of One (1) Megawatt or Greater And Interconnected with the PHI Power Delivery System”, dated April 20, 2011.

“Operations and Modifications Requirements of Atlantic City Electric Company, Delmarva Power & Light Company, Potomac Electric Power Company (Pepco) – Companies of Pepco Holdings, Inc.”, dated October 10, 2011.

The above Applicable Technical Requirements and Standards can be found at:

<http://www.pjm.com/~media/planning/plan-standards/private-ace/phi-technical-considerations-for-generation-parallel-operations.ashx>

<http://www.pjm.com/~media/planning/plan-standards/private-dpl/phi-operations-and-modifications-requirements.ashx>

SCHEDULE E

WHOLESALE MARKET PARTICIPANT’S AGREEMENT TO CONFORM WITH IRS SAFE HARBOR PROVISIONS FOR NON-TAXABLE STATUS

As provided in Section 24.1 in Attachment O, Appendix 2 in Part VI of the Tariff and subject to the requirements thereof, Wholesale Market Participant represents that it meets all qualifications and requirements as set forth in Section 118(a) and 118(b) of the Internal Revenue Code of 1986, as amended and interpreted by Notice 88-129, 1988-2 C.B. 541, and as amplified and modified in Notices 90-60, 1990-2 C.B. 345, and 2001-82, 2001-2 C.B. 619 (the “IRS Notices”). Wholesale Market Participant agrees to conform with all requirements of the safe harbor provisions specified in the IRS Notices, as they may be amended, as required to confer non-taxable status on some or all of the transfer of property, including money, by Wholesale Market Participant to Transmission Owner with respect to the payment of the Costs of construction and installation of the Transmission Owner Interconnection Facilities specified in this WMPA.

Nothing in Wholesale Market Participant’s agreement pursuant to this Schedule E shall change the indemnification obligations under Section 24.2 in Attachment O, Appendix 2 in Part VI of the Tariff.

SCHEDULE F

SCHEDULE OF NON-STANDARD TERMS & CONDITIONS

Not Required.

Document Content(s)

2095-cf90975c-370e-47f5-b2e3-914248e8833a.PDF.....1-10

2095-08de9bd4-85b0-4e77-882f-0855641262df.PDF.....11-26

2095-0232285d-a928-4f42-a811-4e81703bac85.PDF.....27-28

FERC GENERATED TARIFF FILING.RTF.....29-42