



PJM Interconnection, L.L.C.  
Valley Forge Corporate Center  
955 Jefferson Avenue  
Norristown, PA 19403-2497

Jennifer H. Tribulski  
Senior Counsel  
610.666.4363 | fax 610.666.8211  
tribuj@pjm.com

September 3, 2013

**VIA ELECTRONIC FILING**

Honorable Kimberly D. Bose, Secretary  
Federal Energy Regulatory Commission  
888 First Street, N.E., Room 1A  
Washington, D.C. 20426

**Re: PJM Interconnection, L.L.C. Docket No. ER13-\_\_\_\_\_-000  
Original Service Agreement No. 3636; Queue No. X1-085**

Dear Secretary Bose:

Pursuant to section 205 of the Federal Power Act (“FPA”),<sup>1</sup> and part 35 of the regulations of the Federal Energy Regulatory Commission (“Commission” or “FERC”),<sup>2</sup> PJM Interconnection, L.L.C. (“PJM”) submits for filing an executed Wholesale Market Participation Agreement (“WMPA” or “Agreement”) entered into among PJM, Community Energy Solar, LLC (“Community Energy”) and Jersey Central Power & Light Company, a FirstEnergy Company (“JCPL”), executed on August 12, 2013. PJM is submitting this Agreement for filing because Community Energy intends to engage in wholesale sales in the PJM markets from a generating facility connected to JCPL distribution facilities. PJM requests an effective date of August 12, 2013 for this WMPA, which is designated as Original Service Agreement No. No. 3636<sup>3</sup> and is attached to this filing. The WMPA will facilitate Community Energy’s intent to engage in

---

<sup>1</sup> 16 U.S.C. § 824d (2006).

<sup>2</sup> 18 C.F.R. Part 35 (2010).

<sup>3</sup> Because this WMPA being electronically filed with this transmittal letter contains electronic signatures and not the original signatures of the parties, a copy of the sheet(s) containing the original signatures is included as Attachment A to this transmittal letter.

Honorable Kimberly D. Bose, Secretary  
Re: PJM Interconnection, L.L.C.  
September 3, 2013  
Page 2

jurisdictional wholesale transactions in the PJM markets, which will originate over JCPL's non-jurisdictional distribution facilities.

## I. Background

On February 22, 2006, the Commission issued the GSG Order,<sup>4</sup> which held that the interconnection of a generator to non-jurisdictional distribution facilities is not, in and of itself, action regulated by the FPA.<sup>5</sup> The Commission further stated that the distribution facilities become FERC jurisdictional once a wholesale transaction occurs on the system. This action would, therefore, render any subsequent interconnection to the relevant distribution facilities Commission jurisdictional.

PJM routinely receives requests from generation developers seeking to interconnect at a distribution level, in order to participate in sales to the PJM markets. Where the relevant facilities are non-jurisdictional (because there exists no previously interconnected generator engaging in wholesale transactions), and, in light of the GSG Order, PJM developed the WMPA as a contractual means to address these requests and provide to all affected parties a process to enable PJM to properly track and study this category of generator interconnection, as well as to facilitate the generator's participation in PJM's organized wholesale markets. The WMPA also serves to establish important revenue and (if necessary) operational metering requirements in order to give PJM visibility to pay the generator for output and for potential operational security requirements. In rare instances, a non-jurisdictional interconnection could impact the integrated transmission system. The WMPA process allows PJM to ensure that this contingency is studied and corrected, if necessary.

---

<sup>4</sup> See *PJM Interconnection, L.L.C.*, 114 FERC ¶ 61,191 (2006) ("GSG Order").

<sup>5</sup> See *PJM Interconnection, L.L.C.*, 116 FERC ¶ 61,102 (2006) (Order Denying Rehearing and Clarification and noting the FPA denies the Commission jurisdiction "over facilities used in local distribution"). The Order denies the requests for rehearing filed on behalf of GSG, the American Wind Energy Association and Mendota Hills, LLC.

Honorable Kimberly D. Bose, Secretary  
Re: PJM Interconnection, L.L.C.  
September 3, 2013  
Page 3

At this time FERC has previously accepted a number of WMPAs in earlier filings involving other participants. The instant filing is in the same form as the earlier submittals.<sup>6</sup>

## **II. This WMPA Establishes Reasonable Requirements to Enable Wholesale Transactions Subject to the Commission's Jurisdiction**

The instant WMPA is filed pursuant to the Commission's jurisdiction under Section 205 of the FPA and the Commission's independent jurisdictional authority over wholesale sales of electric energy and related products in PJM's markets. These transactions plainly constitute regulated wholesale transactions pursuant to Section 201(b)(1) of the FPA.<sup>7</sup> Under the FPA, the Commission has broad jurisdiction to regulate the wholesale sale of electricity in interstate commerce.<sup>8</sup> As noted above, the transactions will originate over facilities that are not Commission jurisdictional, namely the distribution facilities. In such circumstances, the Commission parses the transaction so as to apply its jurisdiction to only those aspects of the transaction that are Commission jurisdictional. For example, the Commission applies this logic to determine jurisdiction over an interconnection on a facility used for both retail and wholesale transactions as discussed in Order No. 2003,<sup>9</sup> by segregating the jurisdictional transaction from the retail sales. The Commission noted: "[W]here the 'distribution' facilities have a dual use, *i.e.*, the facilities are used for both wholesale sales and retail sales, the Final Rule applies to

---

<sup>6</sup> See *PJM Interconnection, L.L.C.*, Docket Nos. ER12-2594-000; ER12-2610-000; ER12-2550-000; ER12-2409-000; ER12-2294-000; ER12-2421-000; ER12-2416-000; ER12-2174-000; ER12-2293-000; ER12-2155-000; ER12-2126-000; ER12-2128-000 and ER12-2143-000.

<sup>7</sup> Specifically, the FPA applies "to the transmission of electric energy in interstate commerce and to the sale of electric energy at wholesale in interstate commerce." 16 U.S.C. § 824(b)(1) (*emphasis added*).

<sup>8</sup> See 16 U.S.C. § 824(d) ("Unless the Commission otherwise orders, no change shall be made by any public utility in any such rates, charges, classification, or service, or in any rule, regulation, or contract relating thereto, except after sixty days' notice to the Commission and to the public").

<sup>9</sup> See *Detroit Edison Co. v. FERC*, 334 F.3d 48, 51 (D.C. Cir. 2003) (explaining that the Commission has jurisdiction "over all wholesale service," including wholesale transactions that occur over "local distribution" facilities); See also, *PJM Interconnection, L.L.C.*, 116 FERC ¶ 61,102 (July 31, 2006) at P 22. ("Because no wholesale transaction is being conducted on ComEd's distribution facilities, we find there is no Commission-jurisdictional use of the facilities . . . ." Hence, a wholesale transaction would be a jurisdictional use.).

Honorable Kimberly D. Bose, Secretary  
Re: PJM Interconnection, L.L.C.  
September 3, 2013  
Page 4

interconnections to these facilities only for the purpose of making sales of electric energy for resale in interstate commerce.<sup>10</sup> The Commission bifurcates the use of the facility and applies its jurisdiction only to the applicable transaction, the wholesale sale. Here, the generator's use of, and taking of service over, the distribution facilities does not diminish the Commission's independent jurisdiction to regulate the generator's sale of energy and related products in PJM's organized wholesale markets.

This logic is consistently applied in other areas of Commission jurisdiction as well. For example, the Commission applied similar reasoning when it determined it has jurisdiction to require transmission service over non-jurisdictional local distribution facilities in *Tex-La Electric Cooperative of Texas, Inc.*<sup>11</sup> The Commission noted that it retained authority to order transmission service pursuant to Section 211 of the FPA regardless of any local distribution function of the facilities involved and “. . . transmission services may encompass the use of facilities that in other contexts would be classified as distribution facilities.”<sup>12</sup> Similarly, in *Laguna Irrigation District*, the Commission noted that wholesale customers should be allowed the protection of Section 210 of the FPA based merely on the label attached to the facilities to which they interconnect.<sup>13</sup>

Accordingly, since the WMPA addresses the terms and conditions necessary for the generator to make wholesale sales into the PJM markets, PJM applies the same reasoning as detailed above and believes that an agreement enabling such sales (the WMPA) similarly falls within the Commission's jurisdiction.

---

<sup>10</sup> Order No. 2003 at P804; *Accord* Order No. 2003-C at P 53.

<sup>11</sup> *Tex-La Electric Cooperative of Texas, Inc.*, 67 FERC ¶ 61,019, *final order*, 69 FERC ¶ 61,269 (1994) (“*Tex-La Electric Cooperative*”); See *Laguna Irrigation District*, 95 FERC ¶ 61,305 (2001), *aff'd sub nom. Pacific Gas & Electric Co. v. FERC*, 44 Fed. Appx. 170 (9<sup>th</sup> Cir. 2002) (“*Laguna Irrigation*”).

<sup>12</sup> *Tex-La Electric Cooperative of Texas, Inc.*, 67 FERC ¶ 61,056 n. 36 (emphasis in original).

<sup>13</sup> *Laguna Irrigation*, *supra*.

Honorable Kimberly D. Bose, Secretary  
Re: PJM Interconnection, L.L.C.  
September 3, 2013  
Page 5

Should the Commission disagree and decide not to exercise its jurisdiction over the WMPA, PJM will, nonetheless, require execution of the WMPA by similarly-situated generators and transmission owners as a matter of contract. The matters addressed by the WMPA are essential to preserve the continued integrity of PJM's functions as a grid operator and market administrator; and, as such, are properly deemed reasonable conditions of entry, like other RTO membership requirements, for a generator electing to participate in PJM's voluntary markets.

### **III. The WMPA Applies to Wholesale Sales Only**

PJM submitted the WMPA for filing because the WMPA is a form of agreement not presently contained in either the PJM Open Access Transmission Tariff ("PJM Tariff") or the PJM Operating Agreement. The WMPA applies only to wholesale transactions and is not intended to govern the actual physical interconnection of a generating facility to the distribution system. Therefore, it is immaterial whether the WMPA concerns a new interconnection to a distribution system or a pre-existing interconnection on a distribution system where the pre-existing generator subsequently elects to participate in the PJM markets. The WMPA will be initiated for the purpose of facilitating the wholesale sale and not the interconnection. To date, generator market participants connecting to the distribution system have been receptive to the use of the WMPA as a means to facilitate future sales into the PJM markets and to support the state interconnection processes as well. Further, the WMPA allows a vehicle for PJM to examine the potential reliability impacts the interconnection may have on the grid.

As the GSG Order directs,<sup>14</sup> interconnection to the distribution system is not FERC jurisdictional until wholesale sales begin on the system. Hence, the PJM Tariff would not apply to govern the terms and conditions of the physical interconnection, including the attachment of facilities and terms of use and charges for distribution service needed to afford the generator

---

<sup>14</sup> See GSG Order at P 14.

Honorable Kimberly D. Bose, Secretary  
Re: PJM Interconnection, L.L.C.  
September 3, 2013  
Page 6

access to the PJM Transmission System. Again, PJM's interest is to ensure sufficient visibility and, where necessary, control over generation that is participating as a Market Seller under the PJM Operating Agreement.<sup>15</sup>

#### **IV. The WMPA Differs from the ISA in Numerous Important Aspects**

The WMPA is designed to have a similar format to the PJM Interconnection Service Agreement ("ISA") in order to provide a manageable and familiar document for the participants. Unlike the ISA, however, the WMPA does not address matters involving the actual physical interconnection of the generator to the distribution system or any terms, conditions or charges related to any service provided by the distribution system to the generator. The WMPA contains many provisions also typically found in an ISA that govern the relationship between the generator and PJM. These provisions establish reasonable and necessary standards and qualifications, such as revenue quality metering, both to enable the generator to participate as a Market Seller<sup>16</sup> in PJM's market and to allow PJM's system operations the necessary visibility to the generator for reliability purposes. However, the WMPA is not an ISA and is not intended as a substitute for an interconnection agreement between the owners of the interconnecting physical facilities.

More specifically, the WMPA differs from the ISA in several key respects. First, the WMPA does not contain any reference to attachment facilities necessary for the interconnection. The WMPA also does not reference network upgrades for the interconnection to the distribution facility. In limited circumstances, the Feasibility Study and/or the System Impact Study may conclude that there is a significant impact to other jurisdictional interconnections that are located on the nearest transmission system, or a possible impact to facilities that are located on a nearby Commission-jurisdictional distribution facility. If this were

---

<sup>15</sup> See Amended and Restated Operating Agreement of PJM Interconnection, L.L.C. ("PJM Operating Agreement"), Schedule 1.

<sup>16</sup> See *Market Seller* defined in the PJM Operating Agreement at § 1.23.

Honorable Kimberly D. Bose, Secretary  
Re: PJM Interconnection, L.L.C.  
September 3, 2013  
Page 7

the case, the interconnecting generator could be required to fund network upgrades on the corresponding jurisdictional systems only. In the event additional upgrades were needed, the WMPA contains proposed language concerning “Responsibility for Network or Local Upgrades” in Article 3 of the WMPA. At the discretion of the Parties, they may simply mark this section as “not applicable” or delete the section from the WMPA in its entirety when this contract language is inapplicable (as it will be in the majority of cases).

Generally, the WMPA does not contain security requirements (with the limited exception as explained above), or construction requirements. The WMPA also makes no reference to reactive power requirements, and construction of transmission owner interconnection facilities. These are the key components of the ISA that are not included in the WMPA because these ISA components are not relevant to the wholesale transactions.

#### **V. Waiver and Effective Date**

PJM requests that the Commission grant any and all waivers of the Commission’s rules and regulations that are necessary for acceptance of this filing and the enclosed WMPA. Additionally, PJM requests a waiver of the Commission’s 60-day prior notice requirement to allow an effective date of August 12, 2013, for the WMPA, as set forth in § 1.1 thereof. Waiver is appropriate because the WMPA is being filed within thirty (30) days of its requested effective date. See *Prior Notice and Filing Requirements Under Part II of the Federal Power Act*, 64 FERC ¶ 61,139 at 61,983-84 (1993).

#### **VI. Documents Enclosed**

PJM encloses the following:

1. This Transmittal Letter;
2. WMPA – Original Service Agreement No. 3636; and
3. Attachment A: Copy of sheet containing original signatures.

Honorable Kimberly D. Bose, Secretary  
Re: PJM Interconnection, L.L.C.  
September 3, 2013  
Page 8

**VII. Service**

Copies of this filing have been served upon the parties, Community Energy and JCPL at the addresses listed below, as well as on the affected state utility commission(s) within the PJM region.

**VIII. Correspondence and Communications**

All notices, communications or correspondence addressed to PJM regarding this matter should be directed to, and PJM requests that the Secretary include on the Commission's official service list, the following:

Craig Glazer  
Vice President – Federal Government Policy  
PJM Interconnection, L.L.C.  
1200 G. Street, N.W., Suite 600  
Washington, D.C. 20005  
(202) 423-4743 (Phone)  
(202) 393-7741 (Fax)  
[glazec@pjm.com](mailto:glazec@pjm.com)

Jennifer Tribulski  
Senior Counsel  
PJM Interconnection, L.L.C.  
955 Jefferson Avenue  
Norristown, PA 19403  
(610) 666-4363 (Phone)  
(610) 666-8211 (Fax)  
[tribuj@pjm.com](mailto:tribuj@pjm.com)

Respectfully submitted,



Jennifer H. Tribulski

*Counsel on behalf of  
PJM Interconnection, L.L.C.*



Honorable Kimberly D. Bose, Secretary  
Re: PJM Interconnection, L.L.C.  
September 3, 2013  
Page 9

cc:

Community Energy Solar, LLC  
Three Radnor Corporate Center  
Suite 300  
100 Matsonford Road  
Radnor, PA 19087  
Attn: Interconnections Manager

Jersey Central Power & Light  
76 South Main Street  
A-GO-10  
Akron, OH 44308  
Attn: Mike Thorn, Agreements Support Manager

FE Legal  
FirstEnergy Legal Department  
76 South Main Street  
A-GO-15  
Akron, OH 44308  
Attn: Randall Palmer

New Jersey Board of Public Utilities  
44 South Clinton Avenue  
Trenton, NJ 08609-1241  
Attn: Office of General Counsel

Original Service Agreement No. 3636

Effective Date: August 12, 2013

(PJM Queue #X1-085)

**WHOLESALE MARKET PARTICIPATION AGREEMENT**

**Among**

**PJM INTERCONNECTION, L.L.C.**

**And**

**COMMUNITY ENERGY SOLAR, LLC**

**And**

**JERSEY CENTRAL POWER & LIGHT COMPANY**

Original Service Agreement No. 3636

**WHOLESALE MARKET PARTICIPATION AGREEMENT**

**By and Among  
PJM Interconnection, L.L.C.  
And  
Community Energy Solar, LLC  
And  
Jersey Central Power & Light Company  
(PJM Queue Position #X1-085)**

This Wholesale Market Participation Agreement (“WMPA”) including the Specifications, and Schedules attached hereto and incorporated herein, is entered into in order to effectuate sales of energy and/or capacity into PJM’s wholesale markets, by and between PJM Interconnection, L.L.C., the Regional Transmission Organization for the PJM Region (“Transmission Provider”), Community Energy Solar, LLC (“Wholesale Market Participant”) and Jersey Central Power & Light Company, a FirstEnergy Company (“Transmission Owner” or “JCPL”).

WITNESSETH

WHEREAS, Wholesale Market Participant is developing generation that it intends to use to engage in Wholesale Transactions in PJM’s markets and desires to maintain its proposed generation in the queue that PJM studies for potential reliability impacts to the Transmission System;

WHEREAS, Wholesale Market Participant is seeking to interconnect at a local distribution or sub-transmission facility, which at this time is not subject to FERC jurisdiction; and

WHEREAS, Wholesale Market Participant and Transmission Owner or its affiliate must enter into a separate two-party interconnection agreement (“Interconnection Agreement”) in order to address issues of physical interconnection and local charges that may be presented by the interconnection of Wholesale Market Participant’s generation to the distribution facility.

NOW, THEREFORE, in consideration of the mutual covenants herein contained, together with other good and valuable consideration, the receipt and sufficiency is hereby mutually acknowledged by Transmission Provider, Transmission Owner and Wholesale Market Participant and the parties agree to assume all of the rights and obligations consistent with the rights and obligations relating to Network Upgrades, Local Upgrades and metering requirements set forth in Part VI of the Tariff, as of the effective date of this WMPA, required for Wholesale Market Participant to make Wholesale Transactions in PJM’s markets. The Parties mutually covenant and agree as follows:

## Article 1 – DEFINITIONS and OTHER DOCUMENTS

- 1.0 Defined Terms.** All capitalized terms herein shall have the meanings as set forth in the definitions of such terms as stated in Part I or Part VI, Article 1 of the PJM Open Access Transmission Tariff (“Tariff”), except Wholesale Market Participant which shall be defined in this WMPA as a participant in a Wholesale Transaction.
- 1.1 Effective Date.** This WMPA shall become effective on the date it is executed by all Parties, or, if this WMPA is filed with FERC unexecuted, upon the date specified by FERC. This WMPA shall terminate on such date as mutually agreed upon by the parties, unless earlier terminated consistent with Section 1 in Attachment O, Appendix 2, Part VI of the Tariff.
- 1.2 Assumption of Tariff Obligations.** Wholesale Market Participant agrees to abide by all rules and procedures pertaining to generation and transmission in the PJM Region, including but not limited to the rules and procedures concerning the dispatch of generation or scheduling transmission set forth in the Tariff, the Operating Agreement and the PJM Manuals.
- 1.3 Incorporation Of Other Documents.** All portions of the Tariff and the Operating Agreement pertinent to the subject matter of this WMPA and not otherwise made a part hereof are hereby incorporated herein and made a part hereof.

## Article 2 - NOTICES and MISCELLANEOUS

- 2.0 Notices.** Any notice or request made by any party regarding this WMPA shall be made, consistent with the terms of Subpart B of the Tariff, to the representatives of the other parties.

Transmission Provider:

PJM Interconnection, L.L.C.  
955 Jefferson Avenue  
Valley Forge Corporate Center  
Norristown, PA 19403-2497

Wholesale Market Participant:

Community Energy Solar, LLC  
Three Radnor Corporate Center  
Suite 300  
100 Matsonford Road  
Radnor, PA 19087  
Attn: Interconnections Manager

Transmission Owner:

Jersey Central Power & Light  
76 South Main Street  
A-GO-10  
Akron, OH 44308  
Attn: Mike Thorn, Agreements Support Manager

With copies to:  
FE Legal  
FirstEnergy Legal Department  
76 South Main Street  
A-GO-15  
Akron, OH 44308  
Attn: Randy Palmer

- 2.1 Construction With Other Parts Of The Tariff.** This WMPA shall not be construed as an application for service under Part II or Part III of the Tariff.
- 2.2 Warranty for Facilities Study.** In analyzing and preparing the System Impact Study, and in designing and constructing the Local Upgrades and/or Network Upgrades described in Part II of the Tariff and in the Specifications attached to this WMPA, Transmission Provider, the Transmission Owner(s), and any other subcontractors employed by Transmission Provider have had to, and shall have to, rely on information provided by Wholesale Market Participant and possibly by third parties and may not have control over the accuracy of such information. Accordingly, NEITHER TRANSMISSION PROVIDER, THE TRANSMISSION OWNER(s), NOR ANY OTHER SUBCONTRACTORS EMPLOYED BY TRANSMISSION PROVIDER OR TRANSMISSION OWNER MAKES ANY WARRANTIES, EXPRESS OR IMPLIED, WHETHER ARISING BY OPERATION OF LAW, COURSE OF PERFORMANCE OR DEALING, CUSTOM, USAGE IN THE TRADE OR PROFESSION, OR OTHERWISE, INCLUDING WITHOUT LIMITATION IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, WITH REGARD TO THE ACCURACY, CONTENT, OR CONCLUSIONS OF THE FACILITIES STUDY OR THE SYSTEM IMPACT STUDY IF A FACILITIES STUDY WAS NOT REQUIRED OR OF THE LOCAL UPGRADES AND/OR THE NETWORK UPGRADES, PROVIDED, HOWEVER, that Transmission Provider warrants that the Transmission Owner Facilities described in the Specifications will be designed and constructed (to the extent that Transmission Owner is responsible for design and construction thereof) and operated in accordance with Good Utility Practice, as such term is defined in the Operating Agreement. Wholesale Market Participant acknowledges that it has not relied on any representations or warranties not specifically set forth herein and that no such representations or warranties have formed the basis of its bargain hereunder.
- 2.3 Waiver.** No waiver by any party of one or more defaults by the other in performance of any of the provisions of this WMPA shall operate or be construed as a waiver of any other or further default or defaults, whether of a like or different character.

**2.4 Amendment.** This WMPA or any part thereof, may not be amended, modified, or waived other than by a written document signed by all parties hereto.

**2.5 Addendum of Wholesale Market Participant's Agreement to Conform with IRS Safe Harbor Provisions for Non-Taxable Status.** To the extent required, in accordance with Section 20.1.2 in Attachment O-1 in Part VI of the Tariff, Schedule E to this WMPA shall set forth the Wholesale Market Participant's agreement to conform with the IRS safe harbor provisions for non-taxable status.

## ARTICLE 3 – Responsibility for Network or Local Upgrades

- 3.0 Security for Network or Local Upgrades.** Consistent with Section 212.4 in Part VI of the Tariff, Wholesale Market Participant, on or before the effective date of this WMPA, shall provide the Transmission Provider (for the benefit of the Transmission Owner) with a letter of credit from an agreed provider or other form of security reasonably acceptable to the Transmission Provider and that names the Transmission Provider as beneficiary (“Security”) in the amount of \$0. This amount represents the sum of the estimated Costs, determined consistent with Section 217 in Part VI of the Tariff, of (i) the Local Upgrades and/or Network Upgrades described in Section 3.4 of this WMPA less any Costs already paid by the Wholesale Market Participant. Should Wholesale Market Participant fail to provide Security in the amount or form required in the first sentence of this Section, this WMPA shall be terminated. Wholesale Market Participant acknowledges that its ultimate cost responsibility consistent with Section 217 in Part VI of the Tariff will be based upon the actual Costs of the facilities described in the Specifications to this WMPA, whether greater or lesser than the amount of the Security provided under this Section.
- 3.1 Project Specific Milestones.** During the term of this WMPA, Wholesale Market Participant shall ensure that it meets each of the following milestones:
- 3.1.2 Commercial Operation.** (i) On or before February 29, 2016, Wholesale Market Participant must demonstrate commercial operation of all generating units; (ii) On or before February 29, 2016, Wholesale Market Participant must demonstrate commercial sale or use of energy and, if applicable obtain capacity qualification consistent with the requirements of the Reliability Assurance Agreement Among Load Service Entities in the PJM Region..
- 3.1.3 Documentation.** Within one (1) month following commercial operation of generating unit(s), Wholesale Market Participant must provide certified documentation demonstrating that “as-built” Participant Facility are consistent with applicable PJM studies and agreements. Wholesale Market Participant must also provide PJM with “as-built” electrical modeling data or confirm that previously submitted data remains valid.
- 3.1.4 Interconnection Agreement.** On or before February 28, 2014, Wholesale Market Participant must enter into an Interconnection Agreement with the Interconnected Transmission Owner in order to effectuate the WMPA.

Wholesale Market Participant shall demonstrate the occurrence of each of the foregoing milestones to Transmission Provider’s reasonable satisfaction. Transmission Provider may reasonably extend any such milestone dates, in the event of delays that Wholesale Market Participant (i) did not cause and (ii) could not have remedied through the exercise of due diligence.

Wholesale Market Participant may be permitted to suspend under its Interconnection Agreement with the Transmission Owner, or the Transmission Owner may extend the date by which Wholesale Market Participant must enter into the Interconnection Agreement with it. If such suspension or extension occurs, and at any time before the Wholesale Market Participant makes the first wholesale sale under this WMPA, the Wholesale Market Participant may suspend this WMPA by informing the Transmission Provider and the Transmission Owner in writing that it wishes to suspend under the WMPA, with the condition that, notwithstanding such suspension, the Transmission/Distribution System shall be left in a safe and reliable condition in accordance with Good Utility Practice and Transmission Provider's safety and reliability criteria. Wholesale Market Participant's notice of suspension shall include an estimated duration of the suspension and other information related to the suspension. The suspension period may last up to a maximum of three (3) years from the commencement of suspension, provided, however, if the suspension will result in a Material Modification as defined in Section 1.18A.02 of the Tariff, then such suspension period shall be no greater than one (1) year. In the event Wholesale Market Participant suspended pursuant to this Section 3.1 and has not requested to exit such suspension on or before the expiration of the suspension period described herein, the Wholesale Market Participation Agreement for the Interconnection Request for which Wholesale Market Participant suspended work shall be deemed terminated as of the end of such suspension period. The suspension period shall begin on the date the suspension commences. Milestone dates stated in the Wholesale Market Participation Agreement Section 3.1 shall be deemed to be extended coextensively with any suspension period.



IN WITNESS WHEREOF, Transmission Provider, Wholesale Market Participant and Transmission Owner have caused this WMPA to be executed by their respective authorized officials.

(PJM Queue #X1-085)

Transmission Provider: PJM Interconnection, L.L.C.

By: /s/ P. F. McGlynn                      Director System Planning                      8/12/13  
Name    Title    Date

Printed name of signer: P. F. McGlynn

Wholesale Market Participant: **Community Energy Solar, LLC**

By: /s/ Eric Blank                              President                                      6/24/13  
Name    Title    Date

Printed name of signer: Eric Blank

Transmission Owner: **Jersey Central Power & Light Company**

By: /s/ James V. Fakult                      President                                      8/6/13  
Name    Title    Date

Printed name of signer: James V. Fakult

**SPECIFICATIONS FOR  
WHOLESALE MARKET PARTICIPATION AGREEMENT**

**By and Among  
PJM INTERCONNECTION, L.L.C.**

**And**

**Community Energy Solar, LLC**

**And**

**Jersey Central Power & Light Company  
(PJM Queue Position # X1-085)**

**1.0 Description of generating unit(s)** (the “Participant Facility”) to be used for the provision of wholesale sales into the PJM markets:

a. Name of Participant Facility:

Upper Freehold Solar

b. Location of Participant Facility:

Sharon Station Road, Upper Freehold, New Jersey

c. Size in megawatts of Participant Facility:

Maximum Facility Output of 5.0 MW

d. Description of the equipment configuration:

Photovoltaic DC solar panels connected to DC to AC inverters, connected to step-up 34.5kV high-side transformers.

## **2.0 Rights for Generation Wholesale Market Participant**

### **2.1 Capacity Interconnection Rights:**

Pursuant to and subject to the applicable terms of the Tariff, the Wholesale Market Participant shall have Capacity Interconnection Rights at the Point(s) of Interconnection specified in this Wholesale Market Participation Agreement in the amount of 1.9 MW commencing June 1, 2015. During the time period from the effective date of this WMPA until May 31, 2015 (the “interim time period”), the Wholesale Market Participant may be awarded interim Capacity Interconnection Rights in an amount not to exceed 1.9 MW. The availability and amount of such interim Capacity Interconnection Rights shall be dependent upon completion and results of an interim deliverability study. Any interim Capacity Interconnection Rights awarded during the interim time period shall terminate on May 31, 2015.

To the extent that any portion of the Participant Facility described in Section 1.0 is not a Capacity Resource with Capacity Interconnection Rights, such portion of the Participant Facility shall be an Energy Resource. Pursuant to this WMPA, the Wholesale Market Participant may sell energy into PJM’s markets in an amount equal to the Participant Facility’s Maximum Facility Output indicated in Section 1.0c of the Specifications for this WMPA. PJM reserves the right to limit injections in the event reliability would be affected by output greater than such quantity.


**3.0 Ownership and Location of Metering Equipment.** The metering equipment to be constructed, the capability of the metering equipment to be constructed, and the ownership thereof, as required for the Wholesale Transactions shall be identified on the attached Schedule B to this WMPA, and provided consistent with the PJM manuals.

**SCHEDULES:**

- **SCHEDULE A - SINGLE-LINE DIAGRAM (Showing point of interconnection)**
- **SCHEDULE B - LIST OF METERING EQUIPMENT**
- **SCHEDULE C - LIST OF LOCAL/NETWORK UPGRADES**
- **SCHEDULE D - APPLICABLE TECHNICAL REQUIREMENTS AND STANDARDS**
- **SCHEDULE E - WHOLESALE MARKET PARTICIPANT AGREEMENT TO CONFORM WITH IRS SAFE HARBOR PROVISIONS FOR NON-TAXABLE STATUS**
- **SCHEDULE F - SCHEDULE OF NON-STANDARD TERMS & CONDITIONS**

# SCHEDULE A

## SINGLE-LINE DIAGRAM

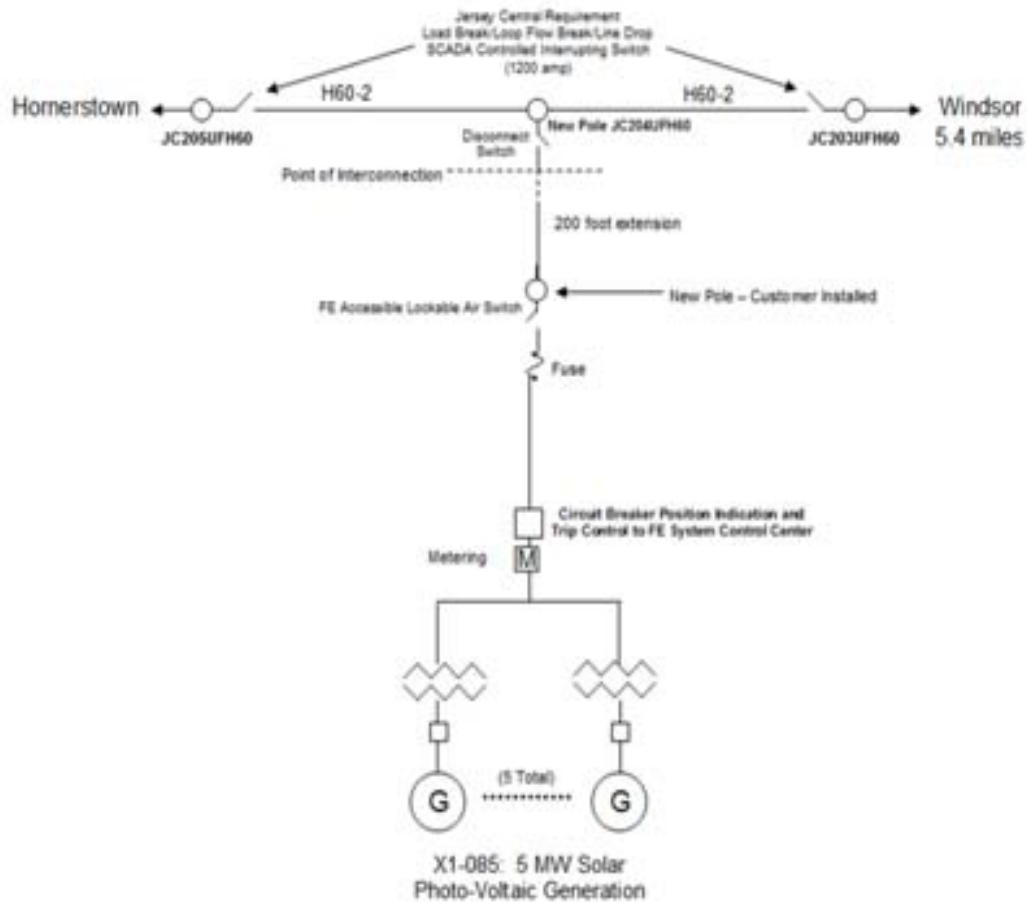

## **SCHEDULE B**

### **LIST OF METERING EQUIPMENT**

Interconnection Customer shall install the necessary equipment to provide “Revenue Metering (KWH, KVARH)” and real time data (KW, KVAR) for the Interconnection Customer’s Customer Facility that comply with the requirements set forth in PJM Manuals M-01 and M-14D.

**SCHEDULE C**

**LIST OF LOCAL/NETWORK UPGRADES**

Not Required.

## **SCHEDULE D**

### **APPLICABLE TECHNICAL REQUIREMENTS AND STANDARDS**

All technical requirements detailed in the X1-085 Revised System Impact Study, January 2013, shall be incorporated herein by reference.

These standards include, but not limited to:

- Technical Requirements for the Interconnection of Customer-Owned Generation to the FirstEnergy Distribution System, effective March 30, 2011
- Wholesale Generation Interconnection Manual, effective August 6, 2010

These standards can be found on the PJM website at:

<http://www.pjm.com/planning/design-engineering/to-tech-standards.aspx>

and the FirstEnergy website at:

<https://www.firstenergycorp.com/feconnect.html>



**SCHEDULE E**  
**WHOLESALE MARKET PARTICIPANT'S AGREEMENT TO CONFORM WITH IRS**  
**SAFE HARBOR PROVISIONS FOR NON-TAXABLE STATUS**

As provided in Section 24.1 in Attachment O, Appendix 2 in Part VI of the Tariff and subject to the requirements thereof, Wholesale Market Participant represents that it meets all qualifications and requirements as set forth in Section 118(a) and 118(b) of the Internal Revenue Code of 1986, as amended and interpreted by Notice 88-129, 1988-2 C.B. 541, and as amplified and modified in Notices 90-60, 1990-2 C.B. 345, and 2001-82, 2001-2 C.B. 619 (the "IRS Notices"). Wholesale Market Participant agrees to conform with all requirements of the safe harbor provisions specified in the IRS Notices, as they may be amended, as required to confer non-taxable status on some or all of the transfer of property, including money, by Wholesale Market Participant to Transmission Owner with respect to the payment of the Costs of construction and installation of the Transmission Owner Interconnection Facilities specified in this WMPA.

Nothing in Wholesale Market Participant's agreement pursuant to this Schedule E shall change the indemnification obligations under Section 24.2 in Attachment O, Appendix 2 in Part VI of the Tariff.

**SCHEDULE F**  
**SCHEDULE OF NON-STANDARD TERMS & CONDITIONS**


Not Required.

**ATTACHMENT A**  
**Copy of Original Signatures**

IN WITNESS WHEREOF, Transmission Provider, Wholesale Market Participant and Transmission Owner have caused this WMPA to be executed by their respective authorized officials.


(PJM Queue #X1-085)

Transmission Provider: PJM Interconnection, L.L.C.

By:  Director System Planning 8/12/13  
Name Title Date


Printed name of signer: P. F. McGlynn

Wholesale Market Participant: **Community Energy Solar, LLC**

By:  President 6/24/13  
Name Title Date

Printed name of signer: ERIC BLANK

Transmission Owner: **Jersey Central Power & Light Company**

By:  President 8/6/13  
Name Title Date

Printed name of signer: JAMES V. FAKULT

FERC rendition of the electronically filed tariff records in Docket No. ER13-02303-000

Filing Data:

CID: C000030

Filing Title: Original Service Agreement No. 3636; Queue No. X1-085

Company Filing Identifier: 1133

Type of Filing Code: 10

Associated Filing Identifier:

Tariff Title: PJM Service Agreements Tariff

Tariff ID: 40

Payment Confirmation:

Suspension Motion:

Tariff Record Data:

Record Content Description, Tariff Record Title, Record Version Number, Option Code:

PJM SA No. 3636, PJM SA No. 3636 Among PJM, Community Energy and JCPL, 0.0.0, A

Record Narrative Name: PJM submits for filing an executed Wholesale Market Participation Agreement entered into among PJM, Community Energy Solar, LLC

and Jersey Central Power & Light Company, a FirstEnergy Company.

Tariff Record ID: 828

Tariff Record Collation Value: 93550 Tariff Record Parent Identifier: 0

Proposed Date: 2013-08-12

Priority Order: 500

Record Change Type: NEW

Record Content Type: 1

Associated Filing Identifier:

Original Service Agreement No. 3636

Effective Date: August 12, 2013

(PJM Queue #X1-085)

**WHOLESALE MARKET PARTICIPATION AGREEMENT**

**Among**

**PJM INTERCONNECTION, L.L.C.**

**And**

**COMMUNITY ENERGY SOLAR, LLC**

**And**

**JERSEY CENTRAL POWER & LIGHT COMPANY**

Original Service Agreement No. 3636

**WHOLESALE MARKET PARTICIPATION AGREEMENT**

**By and Among  
PJM Interconnection, L.L.C.  
And  
Community Energy Solar, LLC  
And  
Jersey Central Power & Light Company  
(PJM Queue Position #X1-085)**

This Wholesale Market Participation Agreement (“WMPA”) including the Specifications, and Schedules attached hereto and incorporated herein, is entered into in order to effectuate sales of energy and/or capacity into PJM’s wholesale markets, by and between PJM Interconnection, L.L.C., the Regional Transmission Organization for the PJM Region (“Transmission Provider”), Community Energy Solar, LLC (“Wholesale Market Participant”) and Jersey Central Power & Light Company, a FirstEnergy Company (“Transmission Owner” or “JCPL”).

WITNESSETH

WHEREAS, Wholesale Market Participant is developing generation that it intends to use to engage in Wholesale Transactions in PJM’s markets and desires to maintain its proposed generation in the queue that PJM studies for potential reliability impacts to the Transmission System;

WHEREAS, Wholesale Market Participant is seeking to interconnect at a local distribution or sub-transmission facility, which at this time is not subject to FERC jurisdiction; and

WHEREAS, Wholesale Market Participant and Transmission Owner or its affiliate must enter into a separate two-party interconnection agreement (“Interconnection Agreement”) in order to address issues of physical interconnection and local charges that may be presented by the interconnection of Wholesale Market Participant’s generation to the distribution facility.

NOW, THEREFORE, in consideration of the mutual covenants herein contained, together with other good and valuable consideration, the receipt and sufficiency is hereby mutually acknowledged by Transmission Provider, Transmission Owner and Wholesale Market Participant and the parties agree to assume all of the rights and obligations consistent with the rights and obligations relating to Network Upgrades, Local Upgrades and metering requirements set forth in Part VI of the Tariff, as of the effective date of this WMPA, required for

Wholesale Market Participant to make Wholesale Transactions in PJM's markets. The Parties mutually covenant and agree as follows:

### **Article 1 – DEFINITIONS and OTHER DOCUMENTS**

- 1.0 Defined Terms.** All capitalized terms herein shall have the meanings as set forth in the definitions of such terms as stated in Part I or Part VI, Article 1 of the PJM Open Access Transmission Tariff (“Tariff”), except Wholesale Market Participant which shall be defined in this WMPA as a participant in a Wholesale Transaction.
- 1.1 Effective Date.** This WMPA shall become effective on the date it is executed by all Parties, or, if this WMPA is filed with FERC unexecuted, upon the date specified by FERC. This WMPA shall terminate on such date as mutually agreed upon by the parties, unless earlier terminated consistent with Section 1 in Attachment O, Appendix 2, Part VI of the Tariff.
- 1.2 Assumption of Tariff Obligations.** Wholesale Market Participant agrees to abide by all rules and procedures pertaining to generation and transmission in the PJM Region, including but not limited to the rules and procedures concerning the dispatch of generation or scheduling transmission set forth in the Tariff, the Operating Agreement and the PJM Manuals.
- 1.3 Incorporation Of Other Documents.** All portions of the Tariff and the Operating Agreement pertinent to the subject matter of this WMPA and not otherwise made a part hereof are hereby incorporated herein and made a part hereof.

### **Article 2 - NOTICES and MISCELLANEOUS**

- 2.0 Notices.** Any notice or request made by any party regarding this WMPA shall be made, consistent with the terms of Subpart B of the Tariff, to the representatives of the other parties.

Transmission Provider:

PJM Interconnection, L.L.C.  
955 Jefferson Avenue  
Valley Forge Corporate Center  
Norristown, PA 19403-2497

Wholesale Market Participant:

Community Energy Solar, LLC

Three Radnor Corporate Center  
Suite 300  
100 Matsonford Road  
Radnor, PA 19087  
Attn: Interconnections Manager



Transmission Owner:

Jersey Central Power & Light  
76 South Main Street  
A-GO-10  
Akron, OH 44308  
Attn: Mike Thorn, Agreements Support Manager

With copies to:  
FE Legal  
FirstEnergy Legal Department  
76 South Main Street  
A-GO-15  
Akron, OH 44308  
Attn: Randy Palmer

- 2.1 Construction With Other Parts Of The Tariff.** This WMPA shall not be construed as an application for service under Part II or Part III of the Tariff.
- 2.2 Warranty for Facilities Study.** In analyzing and preparing the System Impact Study, and in designing and constructing the Local Upgrades and/or Network Upgrades described in Part II of the Tariff and in the Specifications attached to this WMPA, Transmission Provider, the Transmission Owner(s), and any other subcontractors employed by Transmission Provider have had to, and shall have to, rely on information provided by Wholesale Market Participant and possibly by third parties and may not have control over the accuracy of such information. Accordingly, NEITHER TRANSMISSION PROVIDER, THE TRANSMISSION OWNER(s), NOR ANY OTHER SUBCONTRACTORS EMPLOYED BY TRANSMISSION PROVIDER OR TRANSMISSION OWNER MAKES ANY WARRANTIES, EXPRESS OR IMPLIED, WHETHER ARISING BY OPERATION OF LAW, COURSE OF PERFORMANCE OR DEALING, CUSTOM, USAGE IN THE TRADE OR PROFESSION, OR OTHERWISE, INCLUDING WITHOUT LIMITATION IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, WITH REGARD TO THE ACCURACY, CONTENT, OR CONCLUSIONS OF THE FACILITIES STUDY OR THE SYSTEM IMPACT STUDY IF A FACILITIES STUDY WAS NOT REQUIRED OR OF THE LOCAL UPGRADES AND/OR THE NETWORK UPGRADES, PROVIDED, HOWEVER, that Transmission Provider warrants that the Transmission Owner Facilities described in the Specifications will be designed and constructed (to the extent that Transmission Owner is responsible for design and construction thereof) and operated in accordance with Good Utility Practice, as such term is defined in the Operating Agreement. Wholesale Market Participant acknowledges that it has not relied on any representations or warranties not specifically set forth herein and that no such representations or warranties have formed the basis of its bargain hereunder.

**2.3 Waiver.** No waiver by any party of one or more defaults by the other in performance of any of the provisions of this WMPA shall operate or be construed as a waiver of any other or further default or defaults, whether of a like or different character.

**2.4 Amendment.** This WMPA or any part thereof, may not be amended, modified, or waived other than by a written document signed by all parties hereto.

**2.5 Addendum of Wholesale Market Participant's Agreement to Conform with IRS Safe Harbor Provisions for Non-Taxable Status.** To the extent required, in accordance with Section 20.1.2 in Attachment O-1 in Part VI of the Tariff, Schedule E to this WMPA shall set forth the Wholesale Market Participant's agreement to conform with the IRS safe harbor provisions for non-taxable status.

## ARTICLE 3 – Responsibility for Network or Local Upgrades

**3.0 Security for Network or Local Upgrades.** Consistent with Section 212.4 in Part VI of the Tariff, Wholesale Market Participant, on or before the effective date of this WMPA, shall provide the Transmission Provider (for the benefit of the Transmission Owner) with a letter of credit from an agreed provider or other form of security reasonably acceptable to the Transmission Provider and that names the Transmission Provider as beneficiary (“Security”) in the amount of \$0. This amount represents the sum of the estimated Costs, determined consistent with Section 217 in Part VI of the Tariff, of (i) the Local Upgrades and/or Network Upgrades described in Section 3.4 of this WMPA less any Costs already paid by the Wholesale Market Participant. Should Wholesale Market Participant fail to provide Security in the amount or form required in the first sentence of this Section, this WMPA shall be terminated. Wholesale Market Participant acknowledges that its ultimate cost responsibility consistent with Section 217 in Part VI of the Tariff will be based upon the actual Costs of the facilities described in the Specifications to this WMPA, whether greater or lesser than the amount of the Security provided under this Section.

**3.1 Project Specific Milestones.** During the term of this WMPA, Wholesale Market Participant shall ensure that it meets each of the following milestones:

**3.1.2 Commercial Operation.** (i) On or before February 29, 2016, Wholesale Market Participant must demonstrate commercial operation of all generating units; (ii) On or before February 29, 2016, Wholesale Market Participant must demonstrate commercial sale or use of energy and, if applicable obtain capacity qualification consistent with the requirements of the Reliability Assurance Agreement Among Load Service Entities in the PJM Region..

**3.1.3 Documentation.** Within one (1) month following commercial operation of generating unit(s), Wholesale Market Participant must provide certified documentation demonstrating that “as-built” Participant Facility are consistent with applicable PJM studies and agreements. Wholesale Market Participant must also provide PJM with “as-built” electrical modeling data or confirm that previously submitted data remains valid.

**3.1.4 Interconnection Agreement.** On or before February 28, 2014, Wholesale Market Participant must enter into an Interconnection Agreement with the Interconnected Transmission Owner in order to effectuate the WMPA.

Wholesale Market Participant shall demonstrate the occurrence of each of the foregoing milestones to Transmission Provider’s reasonable satisfaction. Transmission Provider may reasonably extend any such milestone dates, in the event of delays that Wholesale Market Participant (i) did not cause and (ii) could

not have remedied through the exercise of due diligence.

Wholesale Market Participant may be permitted to suspend under its Interconnection Agreement with the Transmission Owner, or the Transmission Owner may extend the date by which Wholesale Market Participant must enter into the Interconnection Agreement with it. If such suspension or extension occurs, and at any time before the Wholesale Market Participant makes the first wholesale sale under this WMPA, the Wholesale Market Participant may suspend this WMPA by informing the Transmission Provider and the Transmission Owner in writing that it wishes to suspend under the WMPA, with the condition that, notwithstanding such suspension, the Transmission/Distribution System shall be left in a safe and reliable condition in accordance with Good Utility Practice and Transmission Provider's safety and reliability criteria. Wholesale Market Participant's notice of suspension shall include an estimated duration of the suspension and other information related to the suspension. The suspension period may last up to a maximum of three (3) years from the commencement of suspension, provided, however, if the suspension will result in a Material Modification as defined in Section 1.18A.02 of the Tariff, then such suspension period shall be no greater than one (1) year. In the event Wholesale Market Participant suspended pursuant to this Section 3.1 and has not requested to exit such suspension on or before the expiration of the suspension period described herein, the Wholesale Market Participation Agreement for the Interconnection Request for which Wholesale Market Participant suspended work shall be deemed terminated as of the end of such suspension period. The suspension period shall begin on the date the suspension commences. Milestone dates stated in the Wholesale Market Participation Agreement Section 3.1 shall be deemed to be extended coextensively with any suspension period.

IN WITNESS WHEREOF, Transmission Provider, Wholesale Market Participant and Transmission Owner have caused this WMPA to be executed by their respective authorized officials.

(PJM Queue #X1-085)

Transmission Provider: PJM Interconnection, L.L.C.

By: /s/ P. F. McGlynn Director System Planning  
8/12/13  
Name Title Date

Printed name of signer: P. F. McGlynn

Wholesale Market Participant: **Community Energy Solar, LLC**

By: /s/ Eric Blank President  
6/24/13  
Name Title Date

Printed name of signer: Eric Blank

Transmission Owner: **Jersey Central Power & Light Company**

By: /s/ James V. Fakult President  
8/6/13  
Name Title Date

Printed name of signer: James V. Fakult

**SPECIFICATIONS FOR  
WHOLESALE MARKET PARTICIPATION AGREEMENT**

**By and Among  
PJM INTERCONNECTION, L.L.C.**

**And**

**Community Energy Solar, LLC**

**And**

**Jersey Central Power & Light Company  
(PJM Queue Position # X1-085)**

**1.0 Description of generating unit(s)** (the “Participant Facility”) to be used for the provision of wholesale sales into the PJM markets:

a. Name of Participant Facility:

Upper Freehold Solar

b. Location of Participant Facility:

Sharon Station Road, Upper Freehold, New Jersey

c. Size in megawatts of Participant Facility:

Maximum Facility Output of 5.0 MW

d. Description of the equipment configuration:

Photovoltaic DC solar panels connected to DC to AC inverters, connected to step-up 34.5kV high-side transformers.

## **2.0 Rights for Generation Wholesale Market Participant**

### **2.1 Capacity Interconnection Rights:**

Pursuant to and subject to the applicable terms of the Tariff, the Wholesale Market Participant shall have Capacity Interconnection Rights at the Point(s) of Interconnection specified in this Wholesale Market Participation Agreement in the amount of 1.9 MW commencing June 1, 2015. During the time period from the effective date of this WMPA until May 31, 2015 (the “interim time period”), the Wholesale Market Participant may be awarded interim Capacity Interconnection Rights in an amount not to exceed 1.9 MW. The availability and amount of such interim Capacity Interconnection Rights shall be dependent upon completion and results of an interim deliverability study. Any interim Capacity Interconnection Rights awarded during the interim time period shall terminate on May 31, 2015.

To the extent that any portion of the Participant Facility described in Section 1.0 is not a Capacity Resource with Capacity Interconnection Rights, such portion of the Participant Facility shall be an Energy Resource. Pursuant to this WMPA, the Wholesale Market Participant may sell energy into PJM’s markets in an amount equal to the Participant Facility’s Maximum Facility Output indicated in Section 1.0c of the Specifications for this WMPA. PJM reserves the right to limit injections in the event reliability would be affected by output greater than such quantity.


**3.0 Ownership and Location of Metering Equipment.** The metering equipment to be constructed, the capability of the metering equipment to be constructed, and the ownership thereof, as required for the Wholesale Transactions shall be identified on the attached Schedule B to this WMPA, and provided consistent with the PJM manuals.

**SCHEDULES:**

- **SCHEDULE A - SINGLE-LINE DIAGRAM (Showing point of interconnection)**
- **SCHEDULE B - LIST OF METERING EQUIPMENT**
- **SCHEDULE C - LIST OF LOCAL/NETWORK UPGRADES**
- **SCHEDULE D - APPLICABLE TECHNICAL REQUIREMENTS AND STANDARDS**
- **SCHEDULE E - WHOLESALE MARKET PARTICIPANT AGREEMENT TO CONFORM WITH IRS SAFE HARBOR PROVISIONS FOR NON-TAXABLE STATUS**
- **SCHEDULE F -SCHEDULE OF NON-STANDARD TERMS & CONDITIONS**



**SCHEDULE A**  
**SINGLE-LINE DIAGRAM**

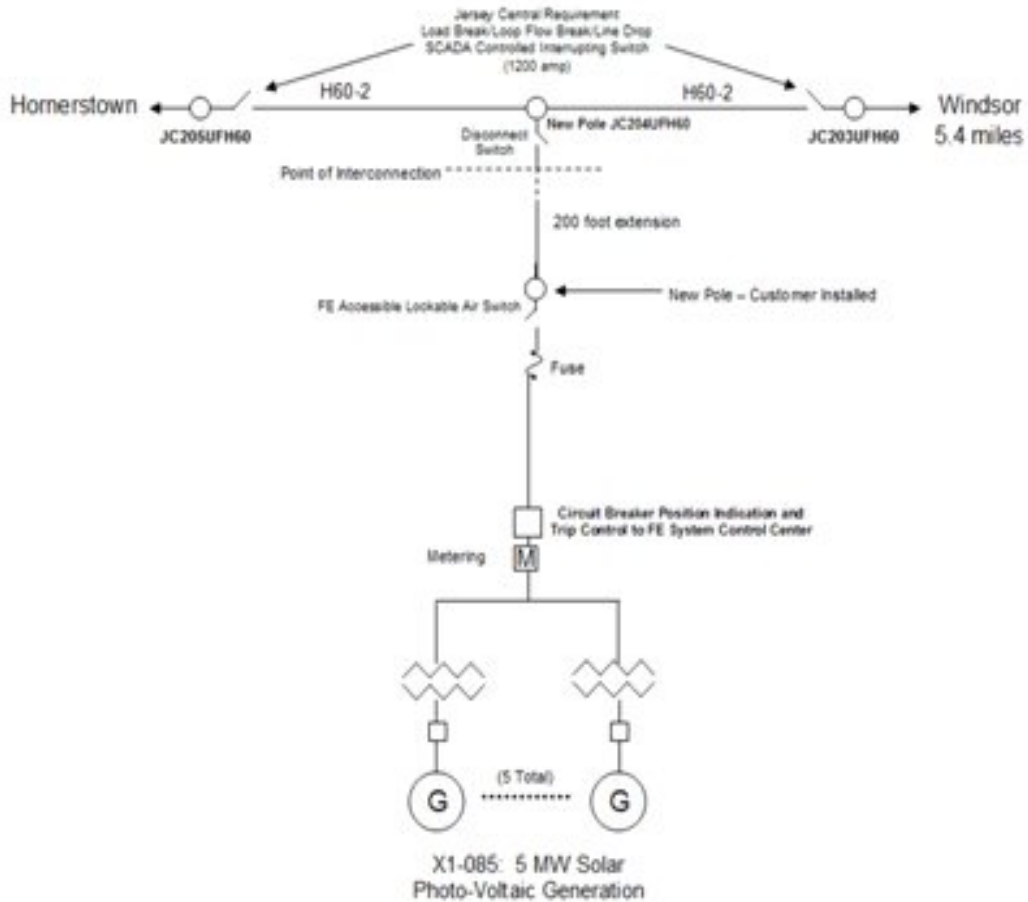

**SCHEDULE B**

**LIST OF METERING EQUIPMENT**

Interconnection Customer shall install the necessary equipment to provide “Revenue Metering (KWH, KVARH)” and real time data (KW, KVAR) for the Interconnection Customer’s Customer Facility that comply with the requirements set forth in PJM Manuals M-01 and M-14D.

**SCHEDULE C**

**LIST OF LOCAL/NETWORK UPGRADES**

Not Required.

## **SCHEDULE D**

### **APPLICABLE TECHNICAL REQUIREMENTS AND STANDARDS**

All technical requirements detailed in the X1-085 Revised System Impact Study, January 2013, shall be incorporated herein by reference.

These standards include, but not limited to:

- Technical Requirements for the Interconnection of Customer-Owned Generation to the FirstEnergy Distribution System, effective March 30, 2011
- Wholesale Generation Interconnection Manual, effective August 6, 2010

These standards can be found on the PJM website at:

<http://www.pjm.com/planning/design-engineering/to-tech-standards.aspx>

and the FirstEnergy website at:

<https://www.firstenergycorp.com/feconnect.html>

## **SCHEDULE E**

### **WHOLESALE MARKET PARTICIPANT'S AGREEMENT TO CONFORM WITH IRS SAFE HARBOR PROVISIONS FOR NON-TAXABLE STATUS**

As provided in Section 24.1 in Attachment O, Appendix 2 in Part VI of the Tariff and subject to the requirements thereof, Wholesale Market Participant represents that it meets all qualifications and requirements as set forth in Section 118(a) and 118(b) of the Internal Revenue Code of 1986, as amended and interpreted by Notice 88-129, 1988-2 C.B. 541, and as amplified and modified in Notices 90-60, 1990-2 C.B. 345, and 2001-82, 2001-2 C.B. 619 (the "IRS Notices"). Wholesale Market Participant agrees to conform with all requirements of the safe harbor provisions specified in the IRS Notices, as they may be amended, as required to confer non-taxable status on some or all of the transfer of property, including money, by Wholesale Market Participant to Transmission Owner with respect to the payment of the Costs of construction and installation of the Transmission Owner Interconnection Facilities specified in this WMPA.

Nothing in Wholesale Market Participant's agreement pursuant to this Schedule E shall change the indemnification obligations under Section 24.2 in Attachment O, Appendix 2 in Part VI of the Tariff.

**SCHEDULE F**  
**SCHEDULE OF NON-STANDARD TERMS & CONDITIONS**

Not Required.

Document Content(s)

1133-ddbfbccce-9c03-47f7-9625-e0fdc5876453.PDF.....1-9

1133-8e205a27-322a-453b-9c6f-34a4ab53ad01.PDF.....10-26

1133-5859b664-c4f7-4b55-84e3-709c1cac9805.PDF.....27-28

FERC GENERATED TARIFF FILING.RTF.....29-44